



464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

LEAD & COPPER IN DRINKING WATER TESTING REPORT

Conducted for:

Greater Bergen Community Action
392 Main Street
Hackensack, New Jersey 07601

Conducted at:

93 Nelson Avenue Head Start
93 Nelson Avenue
Jersey City, New Jersey 07307

Submitted by:

McCabe Environmental Services, L.L.C.
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

REPORT DATE: June 17, 2026

MES PROJECT NO.: 26-05489

Prepared by:

A handwritten signature in blue ink, reading 'Gerard D'Alessio'.

**Gerard D'Alessio
Environmental Scientist**

Signed for the Company by:

A handwritten signature in blue ink, reading 'John H. Chiaviello'.

**John H. Chiaviello
Vice President**

TABLE OF CONTENTS

	<u>Page</u>
1.0 INTRODUCTION	1
2.0 SCOPE OF WORK.....	1
3.0 PROCEDURES.....	1
4.0 TABLE OF SAMPLE RESULTS	2
5.0 DISCUSSION AND CONCLUSION	6

APPENDIX A

Laboratory Certificates of Analysis
&
Sample Chain of Custody Forms

APPENDIX B

Sample Location Drawing

APPENDIX C

Sampling Plan Attachments

1.0 INTRODUCTION

McCabe Environmental Services, L.L.C. (McCabe) was retained by Greater Bergen Community Action (Client) to conduct lead and copper in drinking water testing at 93 Nelson Avenue Head Start located at 93 Nelson Avenue, Jersey City, New Jersey 07307.

The project information is as follows:

<u>Client Name:</u>	Greater Bergen Community Action
<u>Contact Person:</u>	Mr. Raul Torres
<u>Project Name:</u>	93 Nelson Avenue Head Start – Lead & Copper in Drinking Water
<u>Project Location:</u>	93 Nelson Avenue Jersey City, New Jersey 07307
<u>Date(s) of Service:</u>	June 5 th , 2026
<u>McCabe Personnel:</u>	Gerard D'Alessio

2.0 SCOPE OF WORK

Drinking water testing was performed at 93 Nelson Avenue Head Start located at 93 Nelson Avenue, Jersey City, New Jersey 07307 on June 5th, 2026. The purpose of the testing was to determine if the building's plumbing was having an adverse impact on water quality, specifically with regard to lead and copper concentrations. Samples were collected from various potential drinking water outlets located throughout the building.

3.0 PROCEDURES

After determining which outlets would be sampled, McCabe personnel collected a "first draw" sample at each location. A "first draw" is the initial water that is first to come out of the tap after a period of inactivity. Following the "first draw", a "30 second flush" sample was also collected closest to where the main service line comes into the building. All samples were collected into 250 mL sterile bottles, labeled with a sample identification, and analyzed in accordance with EPA approved methods to determine the level of lead in drinking water. Samples were analyzed by an accredited laboratory.

The U.S. Environmental Protection Agency (EPA) has established National Primary Drinking Water Regulations (NPDWR) that set mandatory water quality standards for drinking water contaminants. These are enforceable standards called "maximum contaminant levels" or "MCL", which are established to protect the public against consumption of drinking water contaminants that present a risk to human health. An MCL is the maximum allowable amount of a contaminant in drinking water which is delivered to the consumer.

The EPA has established the Lead and Copper Rule that sets standards for state and public water systems. This rule has set an MCL for lead at 15 parts per billion (ppb) for a one liter sample. However, the EPA also established the Lead in Drinking Water at Schools and Child Care Facilities in which the EPA recommends an MCL of 20 ppb for a 250 milliliter first draw sample. In order to be more stringent, for our report purposes we have compared all results to both the 15 ppb and the 20 ppb standards. The MCL for Copper is set at 1300 ppb.

4.0 TABLE OF SAMPLE RESULTS

The following table presents all sample results in order of sample identification:

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)	Copper Result (ppb)	Copper Exceeds (MCL 1300 ppb)
N- 01	Ground Floor – Room G03 – Food Prep Sink (First Draw)	< 1	Pass	Pass	36	Pass
N- 02	Ground Floor – Room G03 – Food Prep Sink	< 1	Pass	Pass	39	Pass
N- 03	Ground Floor – Room G03 – Bathroom Sink (First Draw)	1	Pass	Pass	64	Pass
N- 04	Ground Floor – Room G05 – Food Prep Sink	< 1	Pass	Pass	47	Pass
N- 05	Ground Floor – Room G07 – Food Prep Sink	< 1	Pass	Pass	54	Pass
N- 06	Ground Floor – Room G07 – Bathroom Sink	< 1	Pass	Pass	11	Pass
N- 07	Ground Floor – Room G09 – Food Prep Sink	< 1	Pass	Pass	26	Pass
N- 08	Ground Floor – Kitchen – Middle Sink	4.5	Pass	Pass	46	Pass
N- 09	Ground Floor – Kitchen – Spray Nozzle Sink	< 1	Pass	Pass	89	Pass
N- 10	Ground Floor – Kitchen – Far Right Sink	1	Pass	Pass	82	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)	Copper Result (ppb)	Copper Exceeds (MCL 1300 ppb)
N- 11	Ground Floor – Room G24 Bathroom –Left Sink	1.4	Pass	Pass	142	Pass
N- 12	Ground Floor – Room G23 Bathroom – Left Sink	1.8	Pass	Pass	150	Pass
N- 13	Room 103 – Food Prep Sink	< 1	Pass	Pass	74	Pass
N- 14	First Floor – Bathroom – FB1 Sink	< 1	Pass	Pass	47	Pass
N- 15	Room 105 – Food Prep Sink	1.2	Pass	Pass	22	Pass
N- 16	Room 105 – Bathroom Sink	< 1	Pass	Pass	29	Pass
N- 17	Room 110 – Bathroom Sink	1	Pass	Pass	164	Pass
N- 18	Room 107 – Food Prep Sink	< 1	Pass	Pass	27	Pass
N- 19	Room 107 – Bathroom Sink	< 1	Pass	Pass	30	Pass
N- 20	1 st Floor – FB4 – Bathroom Sink	1.1	Pass	Pass	71	Pass
N- 21	Room 109 – Food Prep Sink	< 1	Pass	Pass	34	Pass
N- 22	Room 109 – Bathroom Sink	< 1	Pass	Pass	17	Pass
N- 23	Room 111 – Food Prep Sink	< 1	Pass	Pass	21	Pass
N- 24	1 st Floor – FB6 – Bathroom Right Sink	< 1	Pass	Pass	183	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)	Copper Result (ppb)	Copper Exceeds (MCL 1300 ppb)
N- 25	2 nd Floor – Bathroom SB8 – Sink	< 1	Pass	Pass	184	Pass
N- 26	Room 207 – Low Sink	< 1	Pass	Pass	123	Pass
N- 27	2 nd Floor – Bathroom SB7 – Low Sink	1.2	Pass	Pass	56	Pass
N- 28	2nd Floor – Bathroom SB6 – Sink	1	Pass	Pass	67	Pass
N- 29	Room 205 – Low Sink	4.4	Pass	Pass	96	Pass
N- 30	2nd Floor – Room 208 Bathroom Sink	1.5	Pass	Pass	213	Pass
N- 31	Room 203 – Low Sink	< 1	Pass	Pass	55	Pass
N- 32	2nd Floor – Bathroom SB3 – Low Sink	< 1	Pass	Pass	103	Pass
N- 33	2nd Floor – Bathroom 2 – Sink	< 1	Pass	Pass	59	Pass
N- 34	Room 202 – Low Sink	< 1	Pass	Pass	100	Pass
N- 35	Room 202 – Bathroom – Low Sink	< 1	Pass	Pass	187	Pass
N- 36	Room 201 – Low Sink	< 1	Pass	Pass	150	Pass
N- 37	Room 201 – Bathroom – Low Sink	< 1	Pass	Pass	208	Pass
N- 38	Room 302 – Low Sink	1.3	Pass	Pass	120	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)	Copper Result (ppb)	Copper Exceeds (MCL 1300 ppb)
N- 39	Room 302 – Bathroom – Low Sink	< 1	Pass	Pass	108	Pass
N- 40	3 rd Floor Bathroom TB2 – Sink	< 1	Pass	Pass	138	Pass
N- 41	3 rd Floor Bathroom TB3 – Sink	1	Pass	Pass	45	Pass
N- 42	3 rd Floor – Room 303 – Sink	1.6	Pass	Pass	59	Pass
N- 43	3 rd Floor Bathroom TB4 – Sink	3.1	Pass	Pass	162	Pass
N- 44	Room 301 – Bathroom Low Sink	< 1	Pass	Pass	137	Pass
N- 45	Room 301 – Low Sink	1.1	Pass	Pass	152	Pass
N- 46	Room 305 – Low Sink	3	Pass	Pass	99	Pass
N- 47	3 rd Floor Bathroom TB6 – Sink	< 1	Pass	Pass	105	Pass
N- 48	3 rd Floor Bathroom TB7 – Sink	1.2	Pass	Pass	146	Pass
N- 49	Room 307 – Low Sink	19	Fail	Pass	206	Pass
N- 50	3 rd Floor Bathroom TB8 – Sink	6.5	Pass	Pass	268	Pass
N- 51	Ground Floor – Janitor's Closet – Slop Sink	1.2	Pass	Pass	51	Pass
N- 52	Kitchen – Left Sink – G6	2.3	Pass	Pass	41	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)	Copper Result (ppb)	Copper Exceeds (MCL 1300 ppb)
N- 53	Kitchen – Right Sink – G6	3	Pass	Pass	31	Pass

5.0 DISCUSSION AND CONCLUSION

A total of fifty-three (53) samples were collected from 93 Nelson Avenue Head Start. One (1) sample was found to be greater than the EPA Lead and Copper Rule standard of 15 ppb. All other samples were found to be less than the EPA standards of 20 ppb and 15 ppb and 1300 ppb for copper.

The following outlets exceeded the regulatory standard for lead. McCabe recommends discontinued usage of the outlets until additional samples can be collected and analyzed and a permanent solution can be recommended.

- **Room 307 – Low Sink**

Proper signage shall be posted at Room 307 – Low Sink, identifying “Do Not Drink, Safe For Washing Hands.” This sign can be found in Appendix C.

To address the water quality in the short term, McCabe recommends re-testing of those outlets consisting of another first draw sample followed by a thirty (30) second flush sample. It may be appropriate to inspect piping near these fixtures to determine if any corrosion is evident and whether it is possible to replace portions of the piping.

In addition, McCabe Environmental recommends annual drinking water sampling to ensure that the building’s plumbing is not having an adverse impact on water quality.

APPENDIX A

**LABORATORY CERTIFICATES OF ANALYSIS
&
SAMPLE CHAIN OF CUSTODY FORMS**



Monday, June 15, 2026

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Project ID: GREATER BERGEN COMMUNITY ACTION
SDG ID: GCW15764
Sample ID#s: CW15764 - CW15816

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller
Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #M-CT007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

June 15, 2026

SDG I.D.: GCW15764

Project ID: GREATER BERGEN COMMUNITY ACTION

Client Id	Lab Id	Matrix	Col Date
N-01	CW15764	DRINKING WATER	06/05/26 6:28
N-02	CW15765	DRINKING WATER	06/05/26 6:29
N-03	CW15766	DRINKING WATER	06/05/26 6:30
N-04	CW15767	DRINKING WATER	06/05/26 6:31
N-05	CW15768	DRINKING WATER	06/05/26 6:32
N-06	CW15769	DRINKING WATER	06/05/26 6:33
N-07	CW15770	DRINKING WATER	06/05/26 6:34
N-08	CW15771	DRINKING WATER	06/05/26 6:35
N-09	CW15772	DRINKING WATER	06/05/26 6:36
N-10	CW15773	DRINKING WATER	06/05/26 6:37
N-11	CW15774	DRINKING WATER	06/05/26 6:38
N-12	CW15775	DRINKING WATER	06/05/26 6:39
N-13	CW15776	DRINKING WATER	06/05/26 6:40
N-14	CW15777	DRINKING WATER	06/05/26 6:41
N-15	CW15778	DRINKING WATER	06/05/26 6:42
N-16	CW15779	DRINKING WATER	06/05/26 6:43
N-17	CW15780	DRINKING WATER	06/05/26 6:44
N-18	CW15781	DRINKING WATER	06/05/26 6:45
N-19	CW15782	DRINKING WATER	06/05/26 6:46
N-20	CW15783	DRINKING WATER	06/05/26 6:47
N-21	CW15784	DRINKING WATER	06/05/26 6:48
N-22	CW15785	DRINKING WATER	06/05/26 6:49
N-23	CW15786	DRINKING WATER	06/05/26 6:50
N-24	CW15787	DRINKING WATER	06/05/26 6:51
N-25	CW15788	DRINKING WATER	06/05/26 6:52
N-26	CW15789	DRINKING WATER	06/05/26 6:53
N-27	CW15790	DRINKING WATER	06/05/26 6:54
N-28	CW15791	DRINKING WATER	06/05/26 6:55
N-29	CW15792	DRINKING WATER	06/05/26 6:56
N-30	CW15793	DRINKING WATER	06/05/26 6:57



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

June 15, 2026

SDG I.D.: GCW15764

Project ID: GREATER BERGEN COMMUNITY ACTION

Client Id	Lab Id	Matrix	Col Date
N-31	CW15794	DRINKING WATER	06/05/26 6:58
N-32	CW15795	DRINKING WATER	06/05/26 6:59
N-33	CW15796	DRINKING WATER	06/05/26 7:00
N-34	CW15797	DRINKING WATER	06/05/26 7:01
N-35	CW15798	DRINKING WATER	06/05/26 7:02
N-36	CW15799	DRINKING WATER	06/05/26 7:03
N-37	CW15800	DRINKING WATER	06/05/26 7:04
N-38	CW15801	DRINKING WATER	06/05/26 7:05
N-39	CW15802	DRINKING WATER	06/05/26 7:06
N-40	CW15803	DRINKING WATER	06/05/26 7:07
N-41	CW15804	DRINKING WATER	06/05/26 7:08
N-42	CW15805	DRINKING WATER	06/05/26 7:09
N-43	CW15806	DRINKING WATER	06/05/26 7:10
N-44	CW15807	DRINKING WATER	06/05/26 7:11
N-45	CW15808	DRINKING WATER	06/05/26 7:12
N-46	CW15809	DRINKING WATER	06/05/26 7:15
N-47	CW15810	DRINKING WATER	06/05/26 7:20
N-48	CW15811	DRINKING WATER	06/05/26 7:21
N-49	CW15812	DRINKING WATER	06/05/26 7:25
N-50	CW15813	DRINKING WATER	06/05/26 7:30
N-51	CW15814	DRINKING WATER	06/05/26 7:35
N-52	CW15815	DRINKING WATER	06/05/26 7:40
N-53	CW15816	DRINKING WATER	06/05/26 7:45



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:28
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15764

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-01

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	36	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:29
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15765

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-02

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	39	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:30
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15766

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-03

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	64	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:31
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15767

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-04

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	47	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:32
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15768

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-05

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	54	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:33
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15769

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-06

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	11	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:34
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15770

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-07

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	26	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:35
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15771

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-08

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	46	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	4.5	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:36
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15772

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-09

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	89	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:37
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15773

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-10

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	82	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:38
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15774

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-11

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	142	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	1.4	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:39
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15775

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-12

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	150	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	1.8	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:40
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15776

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-13

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	74	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:41
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15777

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-14

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	47	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:42
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15778

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-15

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	22	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	1.2	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:43
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15779

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-16

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	29	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:44
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15780

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-17

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	164	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:45
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15781

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-18

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	27	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:46
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15782

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-19

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	30	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:47
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15783

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-20

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	71	2	1	ppb	1300		1000	06/10/26	TH	E200.7
Lead	1.1	1	1	ppb	15			06/10/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:48
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15784

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-21

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	34	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:49
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15785

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-22

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	17	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:50
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15786

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-23

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	21	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:51
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15787

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-24

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	183	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:52
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15788

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-25

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	184	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:53
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15789

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-26

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	123	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:54
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15790

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-27

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	56	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	1.2	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:55
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15791

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-28

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	67	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:56
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15792

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-29

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	96	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	4.4	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:57
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15793

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-30

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	213	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	1.5	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:58
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15794

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-31

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	55	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

6:59
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15795

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-32

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	103	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:00
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15796

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-33

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	59	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:01
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15797

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-34

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	100	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:02
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15798

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-35

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	187	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:03
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15799

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-36

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	150	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:04
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15800

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-37

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	208	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:05
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15801

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-38

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	120	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	1.3	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:06
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15802

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-39

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	108	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:07
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15803

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-40

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	138	2	1	ppb	1300		1000	06/11/26	TH	E200.7
Lead	< 1	1	1	ppb	15			06/11/26	TH	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:08
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15804

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-41

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	45	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	1	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:09
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15805

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-42

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	59	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	1.6	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:10
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15806

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-43

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	162	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	3.1	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:11
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15807

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-44

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	137	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:12
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15808

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-45

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	152	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	1.1	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:15
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15809

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-46

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	99	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	3	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:20
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15810

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-47

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	105	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	< 1	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:21
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15811

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-48

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	146	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	1.2	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:25
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15812

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-49

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	206	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	19	1	1	ppb	15			06/10/26	CPP	E200.5
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:30
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15813

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-50

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	268	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	6.5	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:35
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15814

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-51

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	51	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	1.2	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:40
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15815

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-52

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	41	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	2.3	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 15, 2026

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#: 26-05489

Custody Information

Collected by: GD
Received by: SR1
Analyzed by: see "By" below

Date

06/05/26
06/05/26

Time

7:45
18:00

Laboratory Data

SDG ID: GCW15764
Phoenix ID: CW15816

Project ID: GREATER BERGEN COMMUNITY ACTION
Client ID: N-53

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	31	2	1	ppb	1300		1000	06/10/26	CPP	E200.7
Lead	3	1	1	ppb	15			06/10/26	CPP	E200.5
Total Metal Digestion	Completed							06/06/26	AG	E200.8
Total Metal Digestion	Completed							06/06/26		E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 15, 2026

Reviewed and Released by: Anil Makol, Project Manager

Analysis Report - Summary

June 15, 2026

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823

SDG I.D.: GCW15764



Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
Project: Greater Bergen Community Action								
CW15764	N-01	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15765	N-02	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15766	N-03	06/05/26	Lead	1	1	ppb	06/10/26	E200.5
CW15767	N-04	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15768	N-05	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15769	N-06	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15770	N-07	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15771	N-08	06/05/26	Lead	4.5	1	ppb	06/10/26	E200.5
CW15772	N-09	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15773	N-10	06/05/26	Lead	1	1	ppb	06/10/26	E200.5
CW15774	N-11	06/05/26	Lead	1.4	1	ppb	06/10/26	E200.5
CW15775	N-12	06/05/26	Lead	1.8	1	ppb	06/10/26	E200.5
CW15776	N-13	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15777	N-14	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15778	N-15	06/05/26	Lead	1.2	1	ppb	06/10/26	E200.5
CW15779	N-16	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15780	N-17	06/05/26	Lead	1	1	ppb	06/10/26	E200.5
CW15781	N-18	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15782	N-19	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15783	N-20	06/05/26	Lead	1.1	1	ppb	06/10/26	E200.5
CW15784	N-21	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15785	N-22	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15786	N-23	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15787	N-24	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15788	N-25	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5

Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
CW15789	N-26	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15790	N-27	06/05/26	Lead	1.2	1	ppb	06/11/26	E200.5
CW15791	N-28	06/05/26	Lead	1	1	ppb	06/11/26	E200.5
CW15792	N-29	06/05/26	Lead	4.4	1	ppb	06/11/26	E200.5
CW15793	N-30	06/05/26	Lead	1.5	1	ppb	06/11/26	E200.5
CW15794	N-31	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15795	N-32	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15796	N-33	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15797	N-34	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15798	N-35	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15799	N-36	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15800	N-37	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15801	N-38	06/05/26	Lead	1.3	1	ppb	06/11/26	E200.5
CW15802	N-39	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15803	N-40	06/05/26	Lead	< 1	1	ppb	06/11/26	E200.5
CW15804	N-41	06/05/26	Lead	1	1	ppb	06/10/26	E200.5
CW15805	N-42	06/05/26	Lead	1.6	1	ppb	06/10/26	E200.5
CW15806	N-43	06/05/26	Lead	3.1	1	ppb	06/10/26	E200.5
CW15807	N-44	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15808	N-45	06/05/26	Lead	1.1	1	ppb	06/10/26	E200.5
CW15809	N-46	06/05/26	Lead	3	1	ppb	06/10/26	E200.5
CW15810	N-47	06/05/26	Lead	< 1	1	ppb	06/10/26	E200.5
CW15811	N-48	06/05/26	Lead	1.2	1	ppb	06/10/26	E200.5
CW15812	N-49	06/05/26	Lead	19	1	ppb	06/10/26	E200.5
CW15813	N-50	06/05/26	Lead	6.5	1	ppb	06/10/26	E200.5
CW15814	N-51	06/05/26	Lead	1.2	1	ppb	06/10/26	E200.5
CW15815	N-52	06/05/26	Lead	2.3	1	ppb	06/10/26	E200.5
CW15816	N-53	06/05/26	Lead	3	1	ppb	06/10/26	E200.5

Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
--------	-----------	-------------	-----------	--------	----	-------	------------------	-----------

Comments:

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

ND=Not detected BDL=Below Detection Level RL=Reporting Level CL=Client Limit


 Phyllis Shiller
 Laboratory Director
 June 15, 2026



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



QA/QC Report

June 15, 2026

QA/QC Data

SDG I.D.: GCW15764

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 844869 (mg/L), QC Sample No: CW15764 (CW15764, CW15765, CW15766, CW15767, CW15768, CW15769, CW15770, CW15771, CW15772)

ICP Metals - Aqueous

Copper	BRL	0.0020	0.036	0.0366	1.70	96.8			96.6			85 - 115	20
Lead	BRL	0.0010	<0.0010	<0.0010	NC	102			99.8			85 - 115	20

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 844869A (mg/L), QC Sample No: CW15774 (CW15773, CW15774, CW15775, CW15776, CW15777, CW15778, CW15779, CW15780, CW15781, CW15782, CW15783)

ICP Metals - Aqueous

Copper	BRL	0.0020				96.8			95.0			85 - 115	20
Lead	BRL	0.0010				102			100			85 - 115	20

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 844875 (mg/L), QC Sample No: CW15784 (CW15784, CW15785, CW15786, CW15787, CW15788, CW15789, CW15790, CW15791, CW15792, CW15793)

ICP Metals - Aqueous

Copper	BRL	0.0020	0.034	0.0331	2.70	101			91.2			85 - 115	20
Lead	BRL	0.0010	<0.0010	<0.0010	NC	109			97.8			85 - 115	20

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 844875A (mg/L), QC Sample No: CW15794 (CW15794, CW15795, CW15796, CW15797, CW15798, CW15799, CW15800, CW15801, CW15802, CW15803)

ICP Metals - Aqueous

Copper	BRL	0.0020				101			97.8			85 - 115	20
Lead	BRL	0.0010				109			104			85 - 115	20

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 844879 (mg/L), QC Sample No: CW15804 (CW15804, CW15805, CW15806, CW15807, CW15808, CW15809, CW15810, CW15811, CW15812, CW15813)

ICP Metals - Aqueous

Copper	BRL	0.0020	0.045	0.0451	0.20	98.6			95.8			85 - 115	20
Lead	BRL	0.0010	0.0010	<0.0010	NC	102			98.8			85 - 115	20

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Data

SDG I.D.: GCW15764

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 844879A (mg/L), QC Sample No: CW15814 (CW15814, CW15815, CW15816)

ICP Metals - Aqueous

Copper	BRL	0.0020				98.6			4.70			85 - 115	20	m
Lead	BRL	0.0010				102			2.50			85 - 115	20	m

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

m = This parameter is outside laboratory MS/MSD specified recovery limits.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

- RPD - Relative Percent Difference
- LCS - Laboratory Control Sample
- LCSD - Laboratory Control Sample Duplicate
- MS - Matrix Spike
- MS Dup - Matrix Spike Duplicate
- NC - No Criteria
- Intf - Interference
- (ISO) - Isotope Dilution



Phyllis Shiller, Laboratory Director
June 15, 2026

Monday, June 15, 2026

Criteria: NJ: DW
State: NJ

Sample Criteria Exceedances Report
GCW15764 - MCCABE-PB

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
CW15812	PB-DWICP	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	19	1	15	1	ppb

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Comments

June 15, 2026

SDG I.D.: GCW15764


The following analysis comments are made regarding exceptions to criteria not already noted in the Analysis Report or QA/QC Report: None.

McCabe Environmental Services, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

LEAD & COPPER in DRINKING WATER

CHAIN-OF-CUSTODY FORM


CLIENT NAME: Greater Bergen Community Action		SITE ADDRESS: 93 Nelson Avenue, Jersey City, New Jersey	
FIELD INSPECTOR'S NAME: G. D'Alessio		TURNAROUND TIME REQUESTED: 2 Week TAT	
MES PROJECT #: 26-05489	SAMPLE DATE: 6/5/2026		
Matrix	SAMPLE ID	SAMPLE LOCATION	ANALYSIS REQUESTED
DW	N-01 157104	Ground Floor - Room G03 - Food Prep Sink (First Draw)	COPPER - 200.7 LEAD - 200.8
DW	N-02 157105	Ground Floor - Room G03 - Food Prep Sink	COPPER - 200.7 LEAD - 200.8
DW	N-03 157106	Ground Floor - Room G03 - Bathroom Sink (First Draw)	COPPER - 200.7 LEAD - 200.8
DW	N-04 157107	Ground Floor - Room G05 - Food Prep Sink	COPPER - 200.7 LEAD - 200.8
DW	N-05 157108	Ground Floor - Room G07 - Food Prep Sink	COPPER - 200.7 LEAD - 200.8
DW	N-06 157109	Ground Floor - Room G07 - Bathroom Sink	COPPER - 200.7 LEAD - 200.8
DW	N-07 157110	Ground Floor - Room G09 - Food Prep Sink	COPPER - 200.7 LEAD - 200.8
DW	N-08 157111	Ground Floor - Kitchen - Middle Sink	COPPER - 200.7 LEAD - 200.8
DW	N-09 157112	Ground Floor - Kitchen - Spray Nozzle Sink	COPPER - 200.7 LEAD - 200.8
DW	N-10 157113	Ground Floor - Kitchen - Far Right Sink	COPPER - 200.7 LEAD - 200.8
Relinquished by (Print) Gerard D'Alessio		Received by: (Print)	Date/Time: 06/05 11:11
Signature: 		Signature:	
Relinquished by (Print)		Received by: (Print)	Date/Time: 06/05 18:00
Signature: 		Signature:	
Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories			

NJ Certified WBE

MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNTHURST, NJ 07071 • PHONE: (201)438-4839 FAX: (201)438-1798

1.8°C
WCP

LEAD & COPPER in DRINKING WATER CHAIN-OF-CUSTODY FORM				
CLIENT NAME: Greater Bergen Community Action			SITE ADDRESS: 93 Nelson Avenue, Jersey City, New Jersey	
FIELD INSPECTOR'S NAME: Gerard D'Alessio			TURNAROUND TIME REQUESTED: 2 Week TAT	
MES PROJECT #: 26-05489		SAMPLE DATE: June 5, 2026		
Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	N- 11 15774	Ground Floor – Room G24 Bathroom – Left Sink	6:38 am	COPPER – 200.7 LEAD – 200.8
DW	N- 12 15775	Ground Floor – Room G23 Bathroom – Left Sink	6:39 am	COPPER – 200.7 LEAD – 200.8
DW	N- 13 15776	Room 103 – Food Prep Sink	6:40 am	COPPER – 200.7 LEAD – 200.8
DW	N- 14 15777	First Floor – Bathroom – FB1 Sink	6:41 am	COPPER – 200.7 LEAD – 200.8
DW	N- 15 15778	Room 105 – Food Prep Sink	6:42 am	COPPER – 200.7 LEAD – 200.8
DW	N- 16 15779	Room 105 – Bathroom Sink	6:43 am	COPPER – 200.7 LEAD – 200.8
DW	N- 17 15780	Room 110 – Bathroom Sink	6:44 am	COPPER – 200.7 LEAD – 200.8
DW	N- 18 15781	Room 107 – Food Prep Sink	6:45 am	COPPER – 200.7 LEAD – 200.8
DW	N- 19 15782	Room 107 – Bathroom Sink	6:46 am	COPPER – 200.7 LEAD – 200.8
DW	N- 20 15783	1st Floor – FB4 – Bathroom Sink	6:47 am	COPPER – 200.7 LEAD – 200.8
Relinquished by (Print) Gerard D'Alessio		Date: 6/5/2026	Time: 9:00	Received by: (Print) 
Signature: 		Date:	Time:	Signature:
Relinquished by (Print)		Date:	Time:	Received by: (Print) 
Signature: 		Date:	Time:	Signature:
Laboratory Analysis performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories				

NJ Certified WBE

McCabe Environmental Services, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201)438-4839 FAX: (201)438-1798

LEAD & COPPER in DRINKING WATER CHAIN-OF-CUSTODY FORM

CLIENT NAME: Greater Bergen Community Action





SITE ADDRESS: 93 Nelson Avenue, Jersey City, New Jersey

FIELD INSPECTOR'S NAME: Gerard D'Alessio

TURNAROUND TIME REQUESTED: 2 Week TAT

MES PROJECT #: 26-05489

SAMPLE DATE: 6/5/2026

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	N- 21 157164	Room 109 – Food Prep Sink	6:48 am	COPPER – 200.7 LEAD – 200.8
DW	N- 22 157165	Room 109 – Bathroom Sink	6:49 am	COPPER – 200.7 LEAD – 200.8
DW	N- 23 157180	Room 111 – Food Prep Sink	6:50 am	COPPER – 200.7 LEAD – 200.8
DW	N- 24 157167	1 st Floor – FB6 – Bathroom Right Sink	6:51 am	COPPER – 200.7 LEAD – 200.8
DW	N- 25 157182	2 nd Floor – Bathroom SB8 – Sink	6:52 am	COPPER – 200.7 LEAD – 200.8
DW	N- 26 157184	Room 207 – Low Sink	6:53 am	COPPER – 200.7 LEAD – 200.8
DW	N- 27 157190	2 nd Floor – Bathroom SB7 – Low Sink	6:54 am	COPPER – 200.7 LEAD – 200.8
DW	N- 28 157191	2 nd Floor – Bathroom SB6 – Sink	6:55 am	COPPER – 200.7 LEAD – 200.8
DW	N- 29 157192	Room 205 – Low Sink	6:56 am	COPPER – 200.7 LEAD – 200.8
DW	N- 30 157193	2 nd Floor – Room 208 Bathroom Sink	6:57 am	COPPER – 200.7 LEAD – 200.8
Relinquished by (Print) Gerard D'Alessio		Date: 6/5/2026	Time: 9:00	Received by: (Print) 
Signature: 				Signature: 
Relinquished by (Print)		Date:	Time:	Received by: (Print) 
Signature: 				Signature: 

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

NJ Certified WBE

MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNDBURST, NJ 07071 • PHONE: (201)438-4839 FAX: (201)438-1798

LEAD & COPPER in DRINKING WATER CHAIN-OF-CUSTODY FORM

CLIENT NAME: Greater Bergen Community Action

SITE ADDRESS: 93 Nelson Avenue, Jersey City, New Jersey

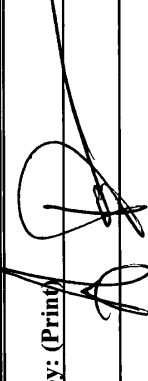

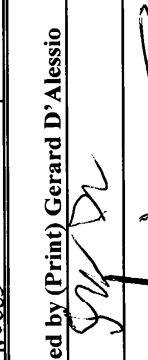

FIELD INSPECTOR'S NAME: Gerard D'Alessio

TURNAROUND TIME REQUESTED: 2 Week TAT

MES PROJECT #: 26-05489

SAMPLE DATE: 6/5/2026

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	N- 31 15794	Room 203 – Low Sink	6:58 am	COPPER – 200.7 LEAD – 200.8
DW	N- 32 15795	2nd Floor – Bathroom SB3 – Low Sink	6:59 am	COPPER – 200.7 LEAD – 200.8
DW	N- 33 15796	2nd Floor – Bathroom 2 – Sink	7:00 am	COPPER – 200.7 LEAD – 200.8
DW	N- 34 15797	Room 202 – Low Sink	7:01 am	COPPER – 200.7 LEAD – 200.8
DW	N- 35 15798	Room 202 – Bathroom – Low Sink	7:02 am	COPPER – 200.7 LEAD – 200.8
DW	N- 36 15799	Room 201 – Low Sink	7:03 am	COPPER – 200.7 LEAD – 200.8
DW	N- 37 15800	Room 201 – Bathroom – Low Sink	7:04 am	COPPER – 200.7 LEAD – 200.8
DW	N- 38 15801	Room 302 – Low Sink	7:05 am	COPPER – 200.7 LEAD – 200.8
DW	N- 39 15802	Room 302 – Bathroom – Low Sink	7:06 am	COPPER – 200.7 LEAD – 200.8
DW	N- 40 15803	3rd Floor Bathroom TB2 – Sink	7:07 am	COPPER – 200.7 LEAD – 200.8





Relinquished by (Print) Gerard D'Alessio	Date: 6/5/2026	Time: 9:00 AM	Received by: (Print) 	Date: 6/5/2026	Time: 11:11
Signature: 			Signature:		
Relinquished by (Print) 	Date:	Time:	Received by: (Print) 	Date:	Time:
Signature:			Signature:		

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

NJ Certified WBE

1.8c
wcp

MCCABE ENVIRONMENTAL SERVICES, L.L.C.
464 VALLEY BROOK AVENUE LYNTHURST, NJ 07071 • PHONE: (201)438-4839 FAX: (201)438-1798

LEAD & COPPER in DRINKING WATER CHAIN-OF-CUSTODY FORM			
CLIENT NAME: Greater Bergen Community Action		SITE ADDRESS: 93 Nelson Avenue, Jersey City, New Jersey	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2 Week TAT	
MES PROJECT #: 26-05489	SAMPLE DATE: 6/5/2026		
Matrix	SAMPLE ID	SAMPLE LOCATION	ANALYSIS REQUESTED
DW	N- 41 15804	3 rd Floor Bathroom TB3 – Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 42 15805	3 rd Floor – Room 303 – Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 43 15806	3 rd Floor Bathroom TB4 – Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 44 15807	Room 301 – Bathroom Low Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 45 15808	Room 301 – Low Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 46 15809	Room 305 – Low Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 47 15810	3 rd Floor Bathroom TB6 – Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 48 15811	3 rd Floor Bathroom TB7 – Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 49 15812	Room 307 – Low Sink	COPPER – 200.7 LEAD – 200.8
DW	N- 50 15813	3 rd Floor Bathroom TB8 – Sink	COPPER – 200.7 LEAD – 200.8
Relinquished by (Print) Gerard D'Alessio		Received by: (Print)	Date: 6/5/2026
Signature: 		Signature: 	Time: 9:00 AM
Relinquished by (Print)		Received by: (Print)	Date:
Signature: 		Signature: 	Time: 11:11
Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories			

NJ Certified WBE

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

CLIENT NAME: Greater Bergen Community Action

SITE ADDRESS: 93 Nelson Avenue, Jersey City, New Jersey

FIELD INSPECTOR'S NAME: Gerard D'Alessio

TURNAROUND TIME REQUESTED: 2 Week TAT

MES PROJECT #: 26-05489

SAMPLE DATE: 6/5/2026

[illegible]

Relinquished by (Print) Gerard D'Alessio

1000

6/5/2026

Received by: (Print)

Dilbert

Signature:

728

Signature: 

三

Relinquish

Printed by

Received by: (Print)

10-12-1950

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

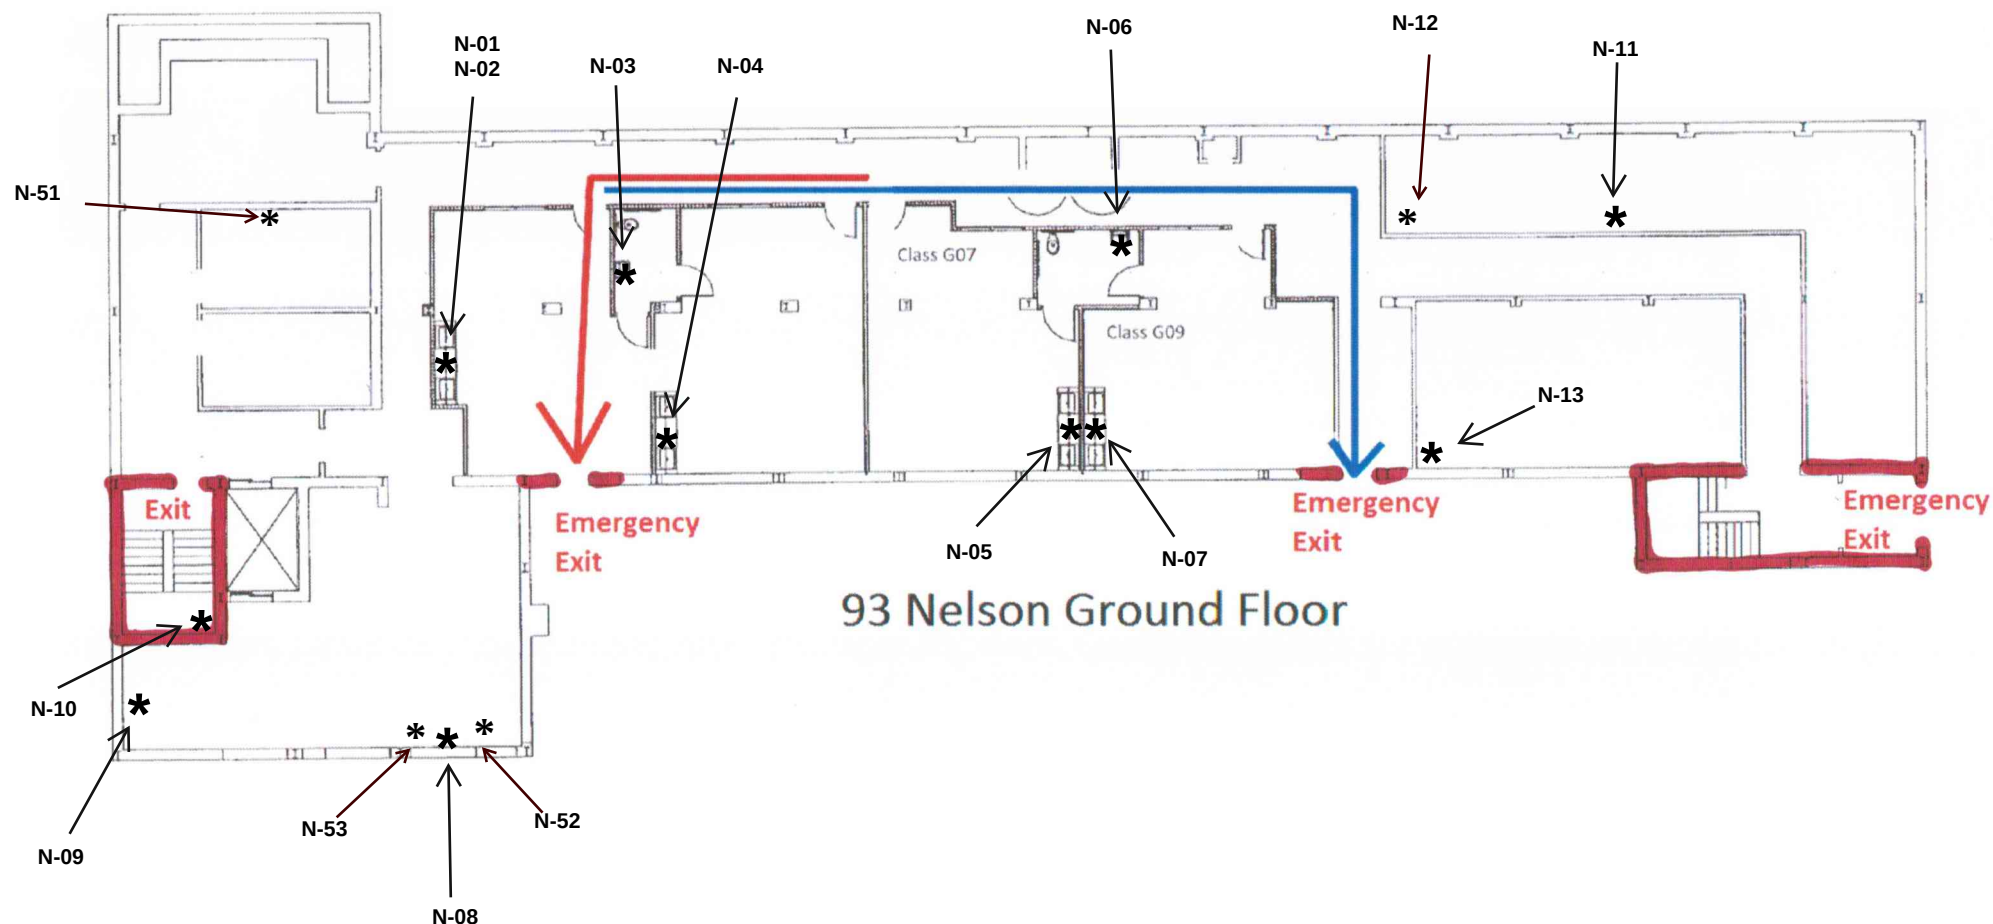
NJ Certified WBE

APPENDIX B

SAMPLE LOCATION DRAWING

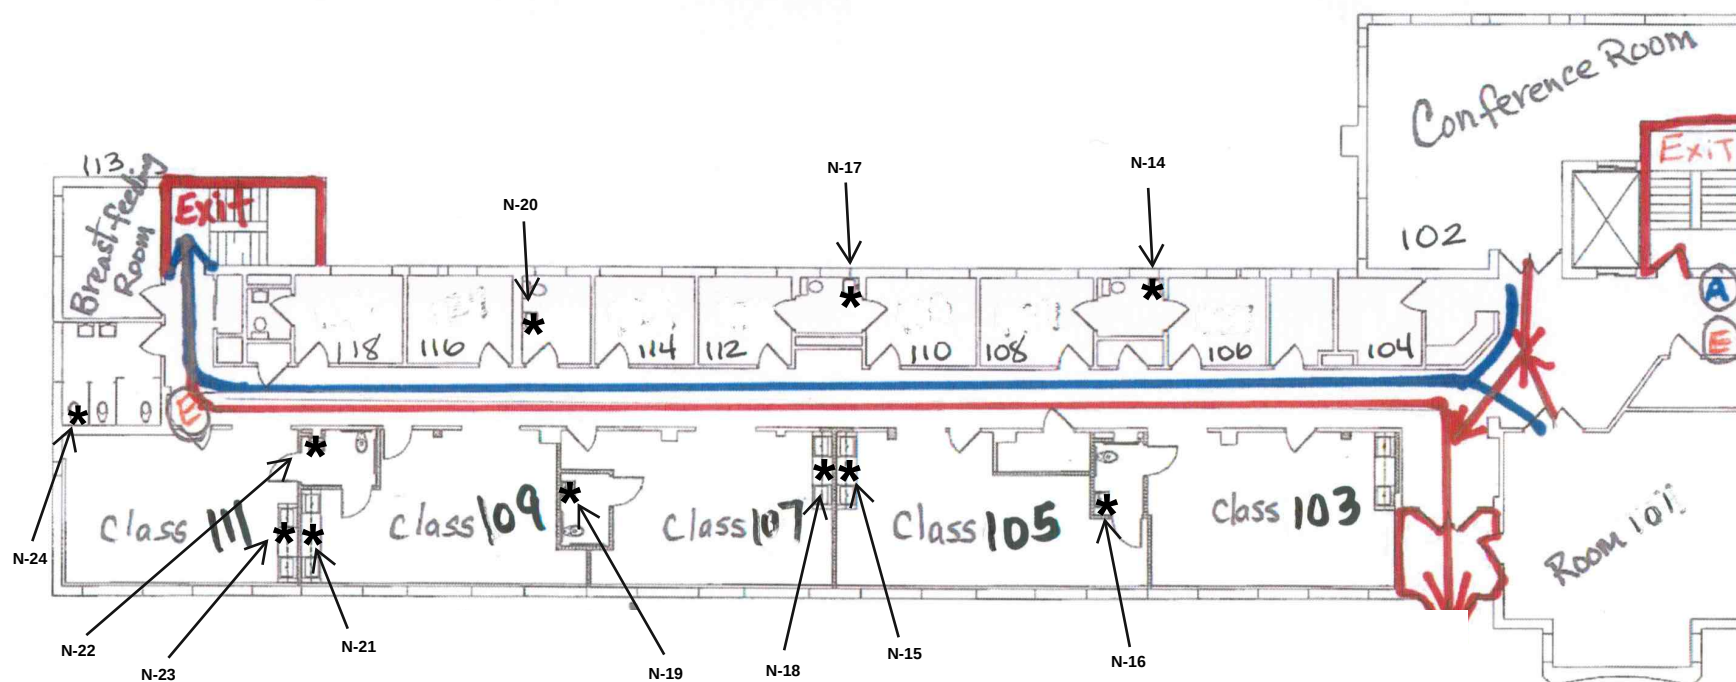
Key

- * = Drinking Water Sampling Location
- Lead Exceeded
- * = Drinking Water Sampling Location



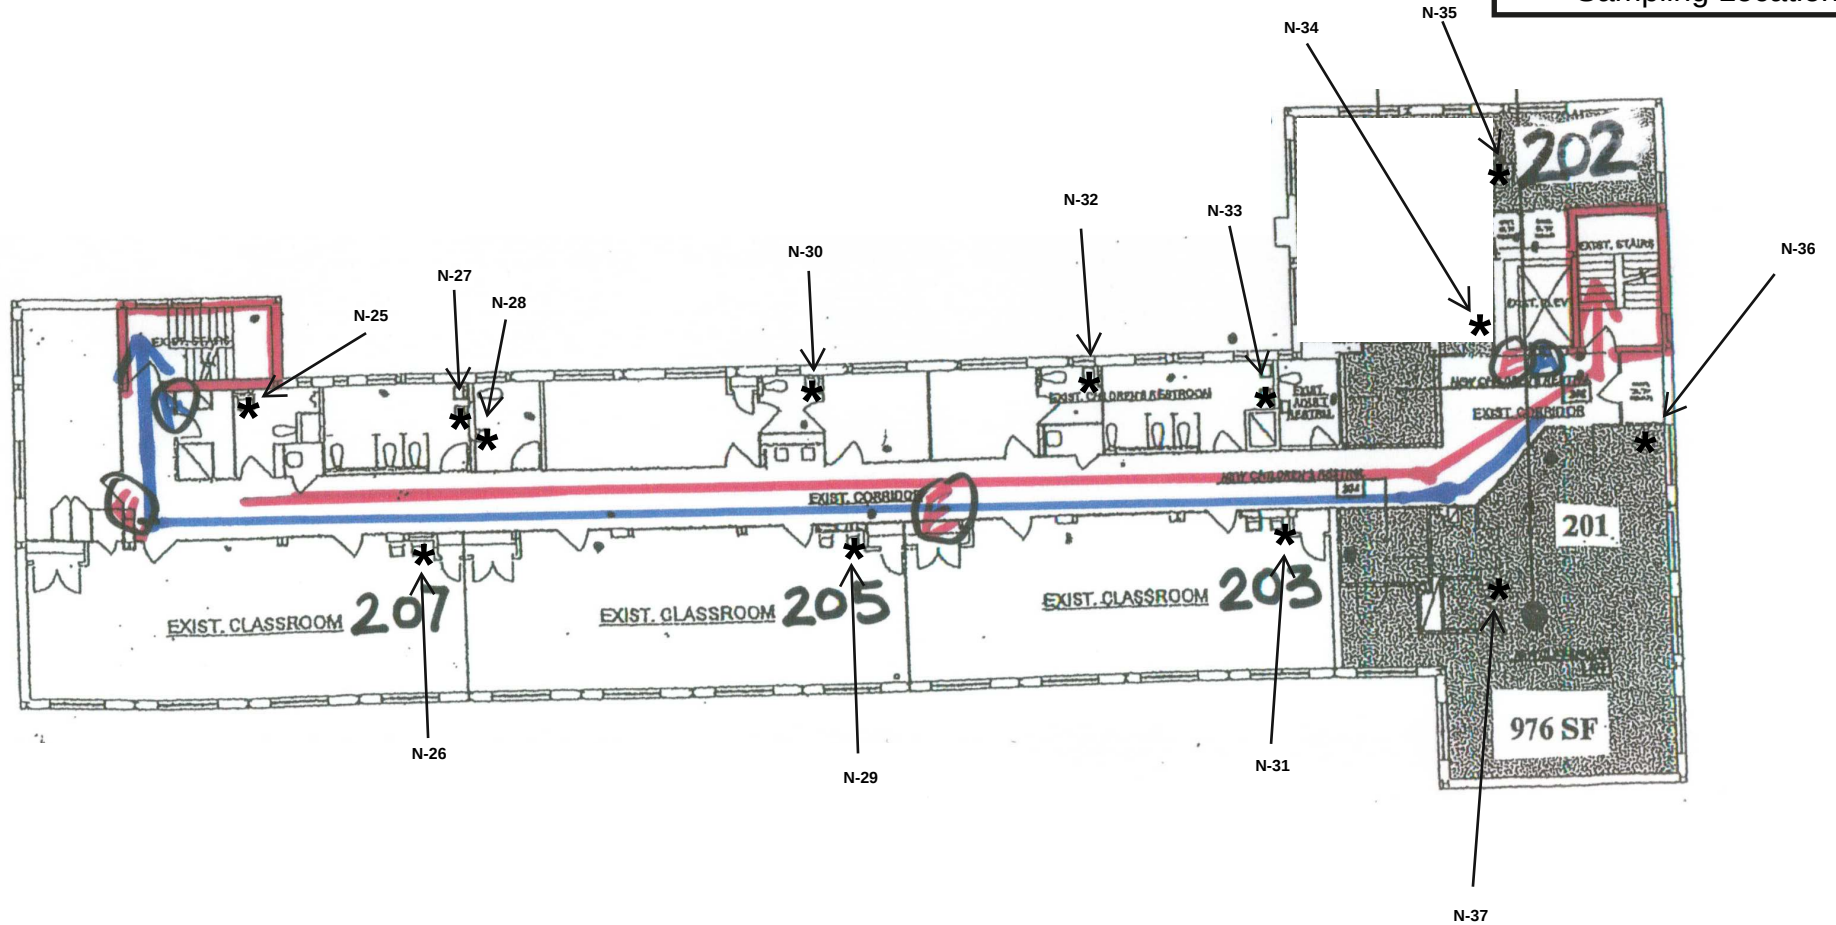
Key

- * = Drinking Water Sampling Location
- Lead Exceeded
- * = Drinking Water Sampling Location



Key

- * = Drinking Water Sampling Location
- Lead Exceeded
- * = Drinking Water Sampling Location

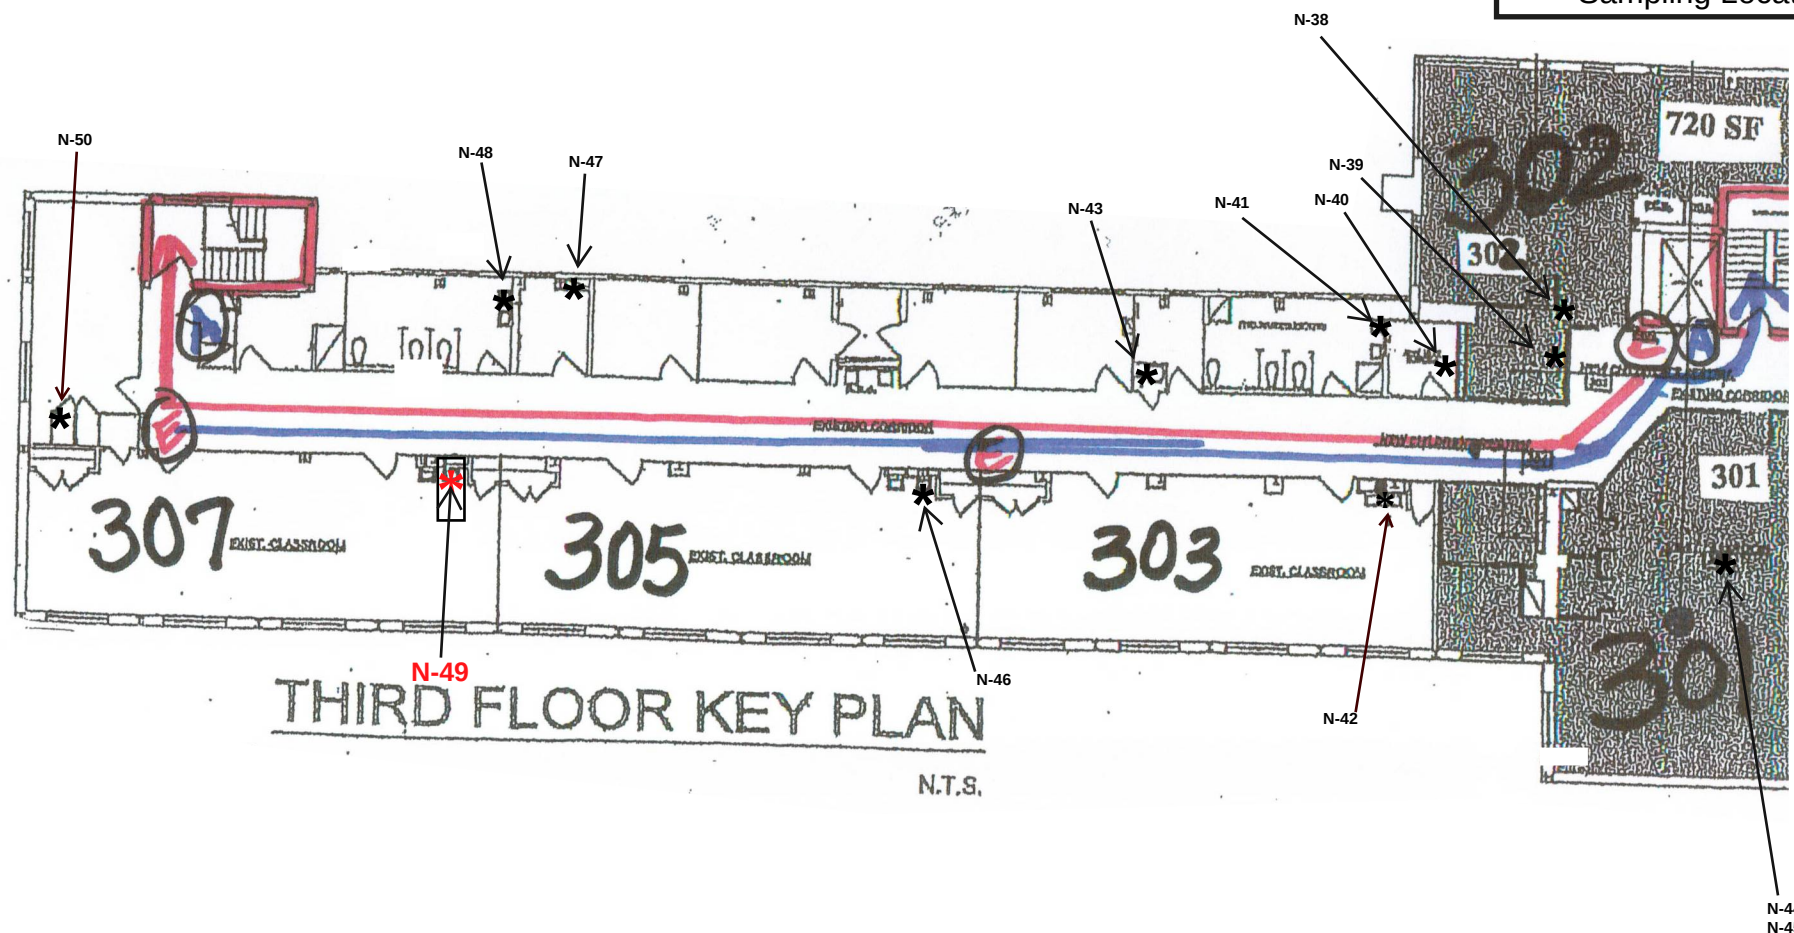


Key

* = Drinking Water
Sampling Location

Lead Exceeded

* = Drinking Water
Sampling Location



APPENDIX C

SAMPLING PLAN ATTACHMENTS

Attachment A - List of Priority for Sampling

SCHOOL NAME	DATE OF SAMPLING	CERTIFIED LABORATORY	NOTES
93 Nelson Avenue Head Start	June 5 th , 2026	Phoenix	

Attachment B – Plumbing Profile

Note: Complete for each school. For additional information see the USEPA publication, “The 3Ts for Reducing Lead in Drinking Water in Schools”

Name of School: 93 Nelson Avenue Head Start Grade Levels: Childcare Facility

Address: 93 Nelson Avenue, Jersey City, New Jersey

Individual school project officer Signature: Raul Torres Date: 06/05/2026

Questions	Answers	
Background Information		
1. What year was the original building constructed? Were any buildings or additions added to the original facility?	1910, Addition in 1958	
2. If the building was constructed or repaired after 1986, was lead-free plumbing and solder utilized? What type of solder was used? Document all locations where lead solder was used.	Unknown	
3. Where are the most recent plumbing repairs and replacements?	Location: None	Description:
4. With what materials is the service connection (the pipe that carries water to the school from the public water system's main in the street) made? Where is the Service Line located? (This is the POE location.)	Material: Steel Location: Basement Level Boiler Room	
5. Is there point of entry (POE) or point of use (POU) treatment in use?	Y / N Type:	Location:

Questions	Answers
6. Are there tanks in your plumbing system (pressure tanks, gravity storage tanks)?	Y / N
7. Does the school have a filter maintenance and operation program? If so, who is responsible for this program? What is the process for adding filters?	NA
8. Have accessible screens or aerators on outlets that provide drinking water been cleaned? Does the school have a screen or aerator maintenance program?	Y / N
9. Have there been any complaints about bad (metallic) taste? Note location(s).	Y / N Location:
10. Review records and consult with the public water supplier to determine whether any water samples have been taken in the building for any contaminants. If so, identify: • Name of contaminant(s) • Concentrations found • pH level Is testing done regularly at the building?	No
11. Other plumbing background questions include: • Are blueprints of the building available? • Are there known plumbing “dead-ends”, low use areas, existing leaks or other “problem areas”? Are renovations planned for any of the plumbing system?	No

Questions	Answers
Walk-Through <i>These questions should be addressed during the walk-through of the facility, while Attachment C- Drinking Water Outlet Inventory is being completed.</i>	
1. Confirm the material of Service Line visually.	Done
2. Confirm the presence of POE or POU treatment.	Done
3. What are the potable water pipes made of in your facility? • Lead • Plastic • Galvanized Metal • Cast Iron • Copper • Other Note the water flow through the building and the areas that receive water first, and which areas receive water last.	Copper, Cast Iron Kitchen and Ground Floor Bathroom/Classrooms
4. Are electrical wires grounded to Water Pipes? Note location(s).	Y / N Location: Boiler Room
5. Are brass fittings, faucets, or valves used in your drinking water system? Note that most faucets are brass on the inside. Document the locations of any brass water outlet to be sampled.	Complete in "Brass" Column in Attachment C- Water Outlet Inventory. Yes-presumed
6. Locate all drinking water outlets (i.e. water coolers, bubblers, ice machines, kitchen/ food prep sinks, etc.) in the facility.	Complete in Attachment C-Water Outlet Inventory. Done

Questions	Answers	
7. Have the brands and models of the water coolers in the school been compared to the list of recalled water coolers in the Toolkit? Recalled Drinking Water Fountains Make and Model	Y / N Type	
8. Have signs of corrosion, such as frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry been detected? Note the locations of water outlets.	Complete in “Signs of Corrosion” column in Attachment C- Drinking Water Outlet Inventory. No	
9. Are there any outlets that are not operational and therefore out of service? Permanently? Temporarily? Permanently Temporarily	Y / N Complete “Operational Column” in Attachment C- Drinking Water Outlet Inventory. Type/ Location	Description

Attachment C – Drinking Water Outlet Inventory

Name of School: 93 Nelson Avenue Head Start

Address: 93 Nelson Avenue, Jersey City, New Jersey

Grade Levels: Childcare Facility

Year School Constructed: NA

Renovated/Additions: NA

Individual School Project Officer: Raul Torres

Date Completed: June 5, 2026

# ¹	Type	Location	Code	Operational ² (Y/N)	Signs of Corrosion ³ (Y/N)	Filter ⁴ (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/ Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
01	Sink	Ground Floor- Room G03- Food Prep Sink (First Draw)	N-01	Y	N	N	N	Y	N	N	N/A	N/A	
02	Sink	Ground Floor- Room G03- Food Prep Sink (30-Sec Flush)	N-02	Y	N	N	N	Y	N	N	N/A	N/A	
03	Sink	Ground Floor- Room G03 Bathroom Sink	N-03	Y	N	N	N	Y	N	N	N/A	N/A	
04	Sink	Ground Floor- Room G05- Food Prep Sink	N-04	Y	N	N	N	Y	N	N	N/A	N/A	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

² Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

³ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

⁴ Document on Attachment D- Filter Inventory.

05	Sink	Ground Floor- Room G07- Food Prep Sink	N-05	Y	N	N	N	Y	N	N	N/A	N/A	
06	Sink	Ground Floor- Room G07- Bathroom Sink	N-06	Y	N	N	N	Y	N	N	N/A	N/A	
07	Sink	Ground Floor- Room G09- Food Prep Sink	N-07	Y	N	N	N	Y	N	N	N/A	N/A	
08	Sink	Kitchen – Middle Sink	N-08	Y	N	N	N	Y	N	N	N/A	N/A	
09	Sink	Kitchen – Spray Nozzle Sink	N-09	Y	N	N	N	Y	N	N	N/A	N/A	
10	Sink	Kitchen – Far Right Sink	N-10	Y	N	N	N	Y	N	N	N/A	N/A	
11	Sink	Ground Floor – Bathroom G24– Left Sink	N-11	Y	N	N	N	Y	N	N	N/A	N/A	
12	Sink	Ground Floor- Bathroom G23- Left Sink	N-12	Y	N	N	N	Y	N	N	N/A	N/A	
13	Sink	Room 103- Food Prep Sink	N-13	Y	N	N	N	Y	N	N	N/A	N/A	
14	Sink	First Floor- Bathroom- FB1 Sink	N-14	Y	N	N	N	Y	N	N	N/A	N/A	
15	Sink	Room 105- Food Prep Sink	N-15	Y	N	N	N	Y	N	N	N/A	N/A	
16	Sink	Room 105 – Bathroom Sink	N-16	Y	N	N	N	Y	N	N	N/A	N/A	
17	Sink	Room 110 - Bathroom Sink	N-17	Y	N	N	N	Y	N	N	N/A	N/A	
18	Sink	Room 107- Food Prep Sink	N-18	Y	N	N	N	Y	N	N	N/A	N/A	
19	Sink	Room 107-	N-19	Y	N	N	N	Y	N	N	N/A	N/A	

		Bathroom - Sink											
20	Sink	First Floor- FB4 - Bathroom Sink	N-20	Y	N	N	N	Y	N	N	N/A	N/A	
21	Sink	Room 109- Food Prep Sink	N-21	Y	N	N	N	Y	N	N	N/A	N/A	
22	Sink	Room 109- Bathroom Sink	N-22	Y	N	N	N	Y	N	N	N/A	N/A	
23	Sink	Room 111- Food Prep Sink	N-23	Y	N	N	N	Y	N	N	N/A	N/A	
24	Sink	First Floor- FB6 Bathroom - Right Sink	N-24	Y	N	N	N	Y	N	N	N/A	N/A	
25	Sink	2 nd Floor- Bathroom SB8- Sink	N-25	Y	N	N	N	Y	N	N	N/A	N/A	
26	Sink	Room 207- Low Sink	N-26	Y	N	N	N	Y	N	N	N/A	N/A	
27	Sink	2 nd Floor- Bathroom SB7- Low Sink	N-27	Y	N	N	N	Y	N	N	N/A	N/A	
28	Sink	2 nd Floor- Bathroom SB6 - Sink	N-28	Y	N	N	N	Y	N	N	N/A	N/A	
29	Sink	Room 205 – Low Sink	N-29	Y	N	N	N	Y	N	N	N/A	N/A	
30	Sink	2 nd Floor- Room 208- Bathroom Sink	N-30	Y	N	N	N	Y	N	N	N/A	N/A	
31	Sink	Room 203- Low Sink	N-31	Y	N	N	N	Y	N	N	N/A	N/A	
32	Sink	2 nd Floor – Bathroom SB3 – Low Sink	N-32	Y	N	N	N	Y	N	N	N/A	N/A	

33	Sink	2 nd Floor- Bathroom 2- Sink	N-33	Y	N	N	N	Y	N	N	N/A	N/A	
34	Sink	Room 202- Low Sink	N-34	Y	N	N	N	Y	N	N	N/A	N/A	
35	Sink	Room 202- Bathroom Low Sink	N-35	Y	N	N	N	Y	N	N	N/A	N/A	
36	Sink	Room 201- Low Sink	N-36	Y	N	N	N	Y	N	N	N/A	N/A	
37	Sink	Room 201- Bathroom Low Sink	N-37	Y	N	N	N	Y	N	N	N/A	N/A	
38	Sink	Room 302- Low Sink	N-38	Y	N	N	N	Y	N	N	N/A	N/A	
39	Sink	Room 302 - Bathroom - Low Sink	N-39	Y	N	N	N	Y	N	N	N/A	N/A	
40	Sink	3 rd Floor- Bathroom TB2 - Sink	N-40	Y	N	N	N	Y	N	N	N/A	N/A	
41	Sink	3 rd Floor – Bathroom TB3 – Low Sink	N-41	Y	N	N	N	Y	N	N	N/A	N/A	
42	Sink	3 rd Floor –Room 303 – Low Sink	N-42	Y	N	N	N	Y	N	N	N/A	N/A	
43	Sink	3 rd Floor – Bathroom TB4 - Sink	N-43	Y	N	N	N	Y	N	N	N/A	N/A	
44	Sink	Room 301 – Bathroom Low Sink	N-44	Y	N	N	N	Y	N	N	N/A	N/A	
45	Sink	Room 301- Low Sink	N-45	Y	N	N	N	Y	N	N	N/A	N/A	

46	Sink	Room 305- Low Sink	N-46	Y	N	N	N	Y	N	N	N/A	N/A	
47	Sink	3 rd Floor – Bathroom TB6 - Sink	N-47	Y	N	N	N	Y	N	N	N/A	N/A	
48	Sink	3 rd Floor- Bathroom TB7- Low Sink	N-48	Y	N	N	N	Y	N	N	N/A	N/A	
49	Sink	Room 307- Low Sink	N-49	Y	N	N	N	Y	N	N	N/A	N/A	
50	Sink	3 rd Floor – Bathroom TB8 - Sink	N-50	Y	N	N	N	Y	N	N	N/A	N/A	
51	Sink	Ground Floor – Janitor Closet – Slop Sink	N-51	Y	N	N	N	Y	N	N	N/A	N/A	
52	Sink	Kitchen- Left Sink	N-53	Y	N	N	N	Y	N	N	N/A	N/A	
53	Sink	Kitchen- Right Sink	N-54	Y	N	N	N	Y	N	N	N/A	N/A	

Attachment D - Filter Inventory

Name of School: 93 Nelson Avenue Head StartGrade Levels: Childcare FacilityAddress: 93 Nelson Avenue, Jersey City, New JerseyIndividual School Project Officer: Raul Torres Date: 6/5/2026

Sample Location / Code	Brand	Type (Make & Model)	Date Installed or Replaced	Replacement Frequency	NSF Certified for Lead Reduction Y/N
N-01	American Standard	N/A	N/A	N/A	N/A
N-02	American Standard	N/A	N/A	N/A	N/A
N-03	American Standard	N/A	N/A	N/A	N/A
N-04	American Standard	N/A	N/A	N/A	N/A
N-05	American Standard	N/A	N/A	N/A	N/A
N-06	American Standard	N/A	N/A	N/A	N/A
N-07	American Standard	N/A	N/A	N/A	N/A
N-08	American Standard	N/A	N/A	N/A	N/A
N-09	American Standard	N/A	N/A	N/A	N/A
N-10	Kohler	N/A	N/A	N/A	N/A
N-11	Kohler	N/A	N/A	N/A	N/A
N-12	Kohler	N/A	N/A	N/A	N/A
N-13	N/A	N/A	N/A	N/A	N/A
N-14	N/A	N/A	N/A	N/A	N/A
N-15	N/A	N/A	N/A	N/A	N/A
N-16	N/A	N/A	N/A	N/A	N/A
N-17	N/A	N/A	N/A	N/A	N/A
N-18	N/A	N/A	N/A	N/A	N/A
N-19	N/A	N/A	N/A	N/A	N/A
N-20	N/A	N/A	N/A	N/A	N/A

N-21	N/A	N/A	N/A	N/A	N/A
N-22	N/A	N/A	N/A	N/A	N/A
N-23	N/A	N/A	N/A	N/A	N/A
N-24	N/A	N/A	N/A	N/A	N/A
N-25	N/A	N/A	N/A	N/A	N/A
N-26	N/A	N/A	N/A	N/A	N/A
N-27	N/A	N/A	N/A	N/A	N/A
N-28	N/A	N/A	N/A	N/A	N/A
N-29	N/A	N/A	N/A	N/A	N/A
N-30	N/A	N/A	N/A	N/A	N/A
N-31	N/A	N/A	N/A	N/A	N/A
N-32	N/A	N/A	N/A	N/A	N/A
N-33	N/A	N/A	N/A	N/A	N/A
N-34	N/A	N/A	N/A	N/A	N/A
N-35	N/A	N/A	N/A	N/A	N/A
N-36	N/A	N/A	N/A	N/A	N/A
N-37	N/A	N/A	N/A	N/A	N/A
N-38	N/A	N/A	N/A	N/A	N/A
N-39	N/A	N/A	N/A	N/A	N/A
N-40	N/A	N/A	N/A	N/A	N/A
N-41	N/A	N/A	N/A	N/A	N/A
N-42	N/A	N/A	N/A	N/A	N/A
N-43	N/A	N/A	N/A	N/A	N/A
N-44	N/A	N/A	N/A	N/A	N/A
N-45	N/A	N/A	N/A	N/A	N/A
N-46	N/A	N/A	N/A	N/A	N/A
N-47	N/A	N/A	N/A	N/A	N/A
N-48	N/A	N/A	N/A	N/A	N/A
N-49	N/A	N/A	N/A	N/A	N/A
N-50	N/A	N/A	N/A	N/A	N/A
N-51	N/A	N/A	N/A	N/A	N/A
N-52	N/A	N/A	N/A	N/A	N/A
N-53	N/A	N/A	N/A	N/A	N/A

Attachment E – Flushing Log

Name of School: 93 Nelson Avenue Head StartGrade Levels: Childcare FacilityAddress: 93 Nelson Avenue, Jersey City, New JerseyIndividual School Project Officer: Raul Torres Date: June 5, 2026

Sample Location Description	Sample Location Code	Date	Time	Duration of Flushing	Reason for Flushing
Ground Floor- Room G03- Food Prep Sink	N-01	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor- Room G03- Food Prep Sink	N-02	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor- Room G03 Bathroom Sink	N-03	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor- Room G05- Food Prep Sink	N-04	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor- Room G07- Food Prep Sink	N-05	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor- Room G07- Bathroom Sink	N-06	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor- Room G09- Food Prep Sink	N-07	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Kitchen – Middle Sink	N-08	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Kitchen – Spray Nozzle Sink	N-09	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Kitchen – Far Right Sink	N-10	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor – Bathroom G24–Left Sink	N-11	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor- Bathroom G23- Left Sink	N-12	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 103- Food Prep Sink	N-13	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
First Floor- Bathroom- FB1 Sink	N-14	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 105- Food Prep Sink	N-15	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 105 – Bathroom Sink	N-16	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 110 - Bathroom Sink	N-17	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 107- Food Prep Sink	N-18	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling

Room 107- Bathroom - Sink	N-19	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
First Floor- FB4 - Bathroom Sink	N-20	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 109- Food Prep Sink	N-21	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 109- Bathroom Sink	N-22	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 111- Food Prep Sink	N-23	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
First Floor- FB6 Bathroom - Right Sink	N-24	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
2 nd Floor- Bathroom SB8- Sink	N-25	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 207- Low Sink	N-26	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
2 nd Floor-Bathroom SB7- Low Sink	N-27	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
2 nd Floor- Bathroom SB6 - Sink	N-28	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 205 – Low Sink	N-29	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
2 nd Floor- Room 208- Bathroom Sink	N-30	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 203- Low Sink	N-31	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
2 nd Floor – Bathroom SB3 – Low Sink	N-32	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
2 nd Floor-Bathroom 2-Sink	N-33	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 202- Low Sink	N-34	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 202- Bathroom Low Sink	N-35	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 201- Low Sink	N-36	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 201- Bathroom Low Sink	N-37	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 302- Low Sink	N-38	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 302 -Bathroom - Low Sink	N-39	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor- Bathroom TB2 - Sink	N-40	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor – Bathroom TB3 – Low Sink	N-41	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor –Room 303 – Low Sink	N-42	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor – Bathroom TB4	N-43	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling

- Sink					
Room 301 – Bathroom Low Sink	N-44	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 301- Low Sink	N-45	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 305- Low Sink	N-46	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor – Bathroom TB6 - Sink	N-47	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor- Bathroom TB7- Low Sink	N-48	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Room 307- Low Sink	N-49	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor – Bathroom TB8 - Sink	N-50	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Ground Floor – Janitor Closet – Slop Sink	N-51	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Kitchen- Left Sink	N-52	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling
Kitchen- Right Sink	N-53	June 4, 2026	3:00 pm	2-3 minutes	Water Sampling

Attachment F - Pre - Sampling Water Use Certification

TO BE COMPLETED BY THE NELSON 1 DISTRICT REPRESENTATIVE:		
School Name:	93 Nelson Avenue Head Start	
Sample collection address:	93 Nelson Avenue Jersey City, New Jersey 07307	
Water was last used:	Time: 3:00 pm	Date: June 4, 2026
Sample commencement:	Time: 7:00 am	Date: June 5, 2026
I have read the Lead Drinking Water Testing Sampling Plan and Quality Assurance Project Plan and I am certifying that samples were collected in accordance with these plans.		
Gerard D'Alessio	June 5, 2026	
Signature	Date	

DO NOT DRINK



SAFE FOR HANDWASHING

