



464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

LEAD & COPPER IN DRINKING WATER TESTING REPORT

Conducted for:

Greater Bergen Community Action
392 Main Street
Hackensack, New Jersey 07601

Conducted at:

Cliffside Park Head Start
263 Lafayette Avenue
Cliffside Park, New Jersey 07010

Submitted by:

McCabe Environmental Services, L.L.C.
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

REPORT DATE: July 23, 2025

MES PROJECT NO.: 25-05233

Prepared by:

A handwritten signature in black ink, appearing to read 'Arllitzy Lezama'.

Arllitzy Lezama
Environmental Scientist

Signed for the Company by:

A handwritten signature in black ink, appearing to read 'John H. Chiaviello'.

John H. Chiaviello
Vice President

TABLE OF CONTENTS

	Page
1.0 INTRODUCTION	1
2.0 SCOPE OF WORK.....	1
3.0 PROCEDURES.....	1
4.0 TABLE OF SAMPLE RESULTS	2
5.0 DISCUSSION AND CONCLUSION	3

APPENDIX A

Laboratory Certificates of Analysis
&
Sample Chain of Custody Forms

APPENDIX B

Sampling Plan Attachments

APPENDIX C

Sample Location Drawing

1.0 INTRODUCTION

McCabe Environmental Services, L.L.C. (McCabe) was retained by Greater Bergen Community Action (Client) to conduct lead in drinking water testing at Cliffside Park Head Start located at 263 Lafayette Avenue, Cliffside Park, New Jersey 07010.

The project information is as follows:

<u>Client Name:</u>	Greater Bergen Community Action
<u>Contact Person:</u>	Mr. Rafael Pampara
<u>Project Name:</u>	Cliffside Park Head Start – Lead & Copper in Drinking Water
<u>Project Location:</u>	263 Lafayette Avenue Cliffside Park, New Jersey 07010
<u>Date(s) of Service:</u>	June 17, 2025
<u>McCabe Personnel:</u>	Gary Clare

2.0 SCOPE OF WORK

Drinking water testing was performed at Cliffside Park Head Start located at 263 Lafayette Avenue, Cliffside Park, New Jersey 07010 on June 17, 2025. The purpose of the testing was to determine if the building's plumbing was having an adverse impact on water quality, specifically with regard to lead and copper concentrations. Samples were collected from various potential drinking water outlets located throughout the building.

3.0 PROCEDURES

After determining which outlets would be sampled, McCabe personnel collected a "first draw" sample at each location. A "first draw" is the initial water that is first to come out of the tap after a period of inactivity. All samples were collected into 250 mL sterile bottles, labeled with a sample identification, and analyzed in accordance with EPA approved methods to determine the level of lead in drinking water. Samples were analyzed by an accredited laboratory.

The U.S. Environmental Protection Agency (EPA) has established National Primary Drinking Water Regulations (NPDWR) that set mandatory water quality standards for drinking water contaminants. These are enforceable standards called "maximum contaminant levels" or "MCL", which are established to protect the public against consumption of drinking water contaminants that present a risk to human health. An MCL is the maximum allowable amount of a contaminant in drinking water which is delivered to the consumer.

The EPA has established the Lead and Copper Rule that sets standards for state and public water systems. This rule has set an MCL for lead at 15 parts per billion (ppb) for a one liter sample. However, the EPA also established the Lead in Drinking Water at Schools and Child Care Facilities in which the EPA recommends an MCL of 20 ppb for a 250 milliliter first draw sample. In order to be more stringent, for our report purposes we have compared all results to both the 15 ppb and the 20 ppb standards. The MCL for Copper is set at 1300 ppb.

4.0 TABLE OF SAMPLE RESULTS

The following table presents all sample results in order of sample identification:

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)	Copper Result	Exceeds (MCL 1300 ppb)
DW-01	Kitchen Sink –Side B	< 0.5	Pass	Pass	26	Pass
DW-02	Kitchen Sink – Side D	3.6	Pass	Pass	132	Pass
DW-03	Room 107 Classroom Sink	3.2	Pass	Pass	44	Pass
DW-04	Room 107 Bathroom Sink	< 0.5	Pass	Pass	29	Pass
DW-05	Gym – Girls Bathroom Left Sink	< 0.5	Pass	Pass	30	Pass
DW-06	Gym – Boys Bathroom Right Sink	0.7	Pass	Pass	35	Pass
DW-07	First Floor Boy’s Bathroom – Middle Sink	0.7	Pass	Pass	47	Pass
DW-08	Room 104 Bathroom Sink	< 0.5	Pass	Pass	33	Pass
DW-09	First Floor Girls Bathroom – Middle Sink	1.1	Pass	Pass	11	Pass
DW-10	Health Director Office (Nurse) - Sink	1	Pass	Pass	14	Pass
DW-11	Adult Bathroom – Sink – 2 nd Floor	< 0.5	Pass	Pass	< 5	Pass
DW-12	2 nd Floor Girls Bathroom – Left Sink	1.5	Pass	Pass	46	Pass
DW-13	3 rd Floor Adult Bathroom - Sink	< 0.5	Pass	Pass	< 5	Pass

5.0 DISCUSSION AND CONCLUSION

A total of thirteen (13) samples were collected from Cliffside Park Head Start. All samples were found to be less than the EPA Lead in Drinking Water at Schools and Child Care Facilities standard of 20 ppb, as well as the EPA Lead and Copper Rule standard of 15 ppb. All samples were also found to be less than the 1300 ppb standard for copper.

In addition, McCabe Environmental recommends annual drinking water sampling to ensure that the building's plumbing is not having an adverse impact on water quality.

APPENDIX A

**LABORATORY CERTIFICATES OF ANALYSIS
&
SAMPLE CHAIN OF CUSTODY FORMS**



Tuesday, June 24, 2025

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
SDG ID: GCT55431
Sample ID#s: CT55431 - CT55443

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller
Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #M-CT007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

June 24, 2025

SDG I.D.: GCT55431

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION

Client Id	Lab Id	Matrix	Col Date
DW-01	CT55431	DRINKING WATER	06/17/25 7:30
DW-02	CT55432	DRINKING WATER	06/17/25 7:32
DW-03	CT55433	DRINKING WATER	06/17/25 7:35
DW-04	CT55434	DRINKING WATER	06/17/25 7:38
DW-05	CT55435	DRINKING WATER	06/17/25 7:40
DW-06	CT55436	DRINKING WATER	06/17/25 7:42
DW-07	CT55437	DRINKING WATER	06/17/25 7:45
DW-08	CT55438	DRINKING WATER	06/17/25 7:47
DW-09	CT55439	DRINKING WATER	06/17/25 7:52
DW-10	CT55440	DRINKING WATER	06/17/25 7:55
DW-11	CT55441	DRINKING WATER	06/17/25 8:00
DW-12	CT55442	DRINKING WATER	06/17/25 8:00
DW-13	CT55443	DRINKING WATER	06/17/25 8:05



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:30
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55431

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-01

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	26	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	< 0.5	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:32
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55432

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-02

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	132	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	3.6	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:35
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55433

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-03

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	44	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	3.2	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:38
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55434

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-04

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	29	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	< 0.5	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:40
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55435

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-05

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	30	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	< 0.5	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:42
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55436

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-06

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	35	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	0.7	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:45
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55437

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-07

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	47	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	0.7	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:47
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55438

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-08

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	33	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	< 0.5	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:52
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55439

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-09

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	11	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	1.1	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

7:55
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55440

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-10

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	14	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	1	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

8:00
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55441

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-11

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	< 5	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	< 0.5	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

8:00
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55442

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-12

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	46	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	1.5	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



Analysis Report

June 24, 2025

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GC
Received by: CP
Analyzed by: see "By" below

Date

06/17/25
06/18/25

Time

8:05
18:10

Laboratory Data

SDG ID: GCT55431
Phoenix ID: CT55443

Project ID: 25-05233 GREATER BERGEN COMMUNITY ACTION
Client ID: DW-13

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Copper	< 5	5	2	ppb	1300		1000	06/20/25	MGH	E200.8
Lead	< 0.5	0.5	2	ppb	15			06/20/25	MGH	E200.8
Total Metal Digestion	Completed							06/19/25	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Secondary DW Maximum Contaminant Level Goal (MCLG): 40 CFR Part 143 Secondary Goals. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

June 24, 2025

Reviewed and Released by: Anil Makol, Project Manager

Analysis Report - Summary

June 24, 2025

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823

SDG I.D.: GCT55431



Sample	Client Id	Col Date	Parameter	Result	RL	CL	Units	Date Analyzed	Reference
Project: 25-05233 Greater Bergen Community Action									
CT55431	DW-01	06/17/25	Lead	< 0.5	0.5		ppb	06/20/25	E200.8
CT55432	DW-02	06/17/25	Lead	3.6	0.5		ppb	06/20/25	E200.8
CT55433	DW-03	06/17/25	Lead	3.2	0.5		ppb	06/20/25	E200.8
CT55434	DW-04	06/17/25	Lead	< 0.5	0.5		ppb	06/20/25	E200.8
CT55435	DW-05	06/17/25	Lead	< 0.5	0.5		ppb	06/20/25	E200.8
CT55436	DW-06	06/17/25	Lead	0.7	0.5		ppb	06/20/25	E200.8
CT55437	DW-07	06/17/25	Lead	0.7	0.5		ppb	06/20/25	E200.8
CT55438	DW-08	06/17/25	Lead	< 0.5	0.5		ppb	06/20/25	E200.8
CT55439	DW-09	06/17/25	Lead	1.1	0.5		ppb	06/20/25	E200.8
CT55440	DW-10	06/17/25	Lead	1	0.5		ppb	06/20/25	E200.8
CT55441	DW-11	06/17/25	Lead	< 0.5	0.5		ppb	06/20/25	E200.8
CT55442	DW-12	06/17/25	Lead	1.5	0.5		ppb	06/20/25	E200.8
CT55443	DW-13	06/17/25	Lead	< 0.5	0.5		ppb	06/20/25	E200.8

Comments:

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

ND=Not detected BDL=Below Detection Level RL=Reporting Level CL=Client Limit


Phyllis Shiller
Laboratory Director
June 24, 2025



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102



QA/QC Report

June 24, 2025

QA/QC Data

SDG I.D.: GCT55431

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 789879 (mg/L), QC Sample No: CT55431 (CT55431, CT55432, CT55433, CT55434, CT55435, CT55436, CT55437, CT55438, CT55439, CT55440)

ICP MS Metals - Aqueous

Copper	BRL	0.0005	0.026	0.0179	36.9	99.8					96.2		
Lead	BRL	0.0001	<0.0005	0.0005	NC	95.0					91.4		

QA/QC Batch 789879A (mg/L), QC Sample No: CT55441 (CT55441, CT55442, CT55443)

ICP MS Metals - Aqueous

Copper	BRL	0.0005				99.8					98.0		
Lead	BRL	0.0001				95.0					85.8		

Comment:

This batch does not include a duplicate.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

- RPD - Relative Percent Difference
- LCS - Laboratory Control Sample
- LCSD - Laboratory Control Sample Duplicate
- MS - Matrix Spike
- MS Dup - Matrix Spike Duplicate
- NC - No Criteria
- Intf - Interference
- (ISO) - Isotope Dilution


Phyllis Shiller, Laboratory Director
June 24, 2025

Tuesday, June 24, 2025

Criteria: NJ: DW

State: NJ

Sample Criteria Exceedances Report
GCT55431 - MCCABE-PB

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
--------	-------	-----------------	----------	--------	----	----------	----------------	-------------------

*** No Data to Display ***

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Comments

June 24, 2025

SDG I.D.: GCT55431

The following analysis comments are made regarding exceptions to criteria not already noted in the Analysis Report or QA/QC Report: None.

2.1° WCIP

MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

LEAD & COPPER in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Greater Bergen Community Action		SITE ADDRESS: 263 Lafayette Avenue, Cliffside Park, New Jersey 07010		
FIELD INSPECTOR'S NAME: G. Clare		TURNAROUND TIME REQUESTED: 2 Weeks		
MES PROJECT #: 25-05233		SAMPLE DATE: 06/17/25		
Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	DW-01	Kitchen Sink - Side B	7:30 am	COPPER - 200.7 LEAD - 200.8
DW	DW-02	Kitchen Sink - Side D	7:32	COPPER - 200.7 LEAD - 200.8
DW	DW-03	Room 107 Classroom Sink	7:35	COPPER - 200.7 LEAD - 200.8
DW	DW-04	Room 107 Bathroom Sink	7:38	COPPER - 200.7 LEAD - 200.8
DW	DW-05	Gym - Girls Bathroom Left Sink	7:40	COPPER - 200.7 LEAD - 200.8
DW	DW-06	Gym - Boys Bathroom - Right Sink	7:42	COPPER - 200.7 LEAD - 200.8
DW	DW-07	1st Fl - Boys Bathroom - Middle Sink	7:45	COPPER - 200.7 LEAD - 200.8
DW	DW-08	Room 104 Bathroom Sink	7:47	COPPER - 200.7 LEAD - 200.8
DW	DW-09	1st Fl. Girls Bathroom Middle Sink	7:52	COPPER - 200.7 LEAD - 200.8
DW	DW-10	Health Director Office (Nurse) - Sink	7:55	COPPER - 200.7 LEAD - 200.8
Relinquished by (Print) Gary Clare		Received by: (Print) Denise Bibeau		Date: 6/17/25 11:00
Signature: <i>GC</i>		Signature: Denise Bibeau		
Relinquished by (Print) Denise Bibeau		Received by: (Print) J. Demers		Date: 6-18 2025
Signature: Denise Bibeau		Signature: <i>JD</i>		
Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories				

GC *Denise Bibeau* 6/18/25 1:00pm
NJ Certified WBE *Daniela*
Auliy See 6/18/25 1810

2.1° WCLP

MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

LEAD & COPPER in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Greater Bergen Community Action		SITE ADDRESS: 263 Lafayette Avenue, Cliffside Park, New Jersey 07010	
FIELD INSPECTOR'S NAME: G. Clare		TURNAROUND TIME REQUESTED: 2 Weeks	
MES PROJECT #: 25-05233		SAMPLE DATE: 06/17/25	

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	DW-11	Adult Bathroom - Sink - 2nd Fl.	55441 8:00	COPPER - 200.7 LEAD - 200.8
DW	DW-12	2nd Fl - Girls Bathroom - Left Sink	55442 8:00	COPPER - 200.7 LEAD - 200.8
DW	DW-13	3rd Fl. - Adult Bathroom - Sink	55443 8:05	COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8
DW				COPPER - 200.7 LEAD - 200.8

Relinquished by (Print) Gary Clare	Date: 6/17/25	Time: 11:00	Received by: (Print) Denise Bibeau	Date: 6/17/25	Time: 11:00
Signature: <i>GC</i>			Signature: <i>Denise Bibeau</i>		
Relinquished by (Print) Denise Bibeau	Date: 6/18/25	Time: 1010	Received by: (Print) J. Demers	Date: 6.18	Time: 1010
Signature: <i>Denise Bibeau</i>			Signature: <i>J. Demers</i>		

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

Denise Bibeau 6/18/25 1:00pm
Denise Bibeau
 NJ Certified WBE
 Any fee 6/18/25 1810

APPENDIX B

SAMPLING PLAN ATTACHMENTS

Attachment A - List of Priority for Sampling

SCHOOL NAME	DATE OF SAMPLING	CERTIFIED LABORATORY	NOTES
Cliffside Park Head Start	June 17, 2025	Phoenix	

Attachment B – Plumbing Profile

Note: Complete for each school. For additional information see the USEPA publication, “The 3Ts for Reducing Lead in Drinking Water in Schools”

Name of School: Cliffside Park Head Start

Grade Levels: Childcare Facility

Address: 263 Lafayette Avenue, Cliffside Park, New Jersey

Individual school project officer Signature: Gary Clare

Date: June 17, 2025

Questions	Answers	
Background Information		
1. What year was the original building constructed? Were any buildings or additions added to the original facility?	1929	
2. If the building was constructed or repaired after 1986, was lead-free plumbing and solder utilized? What type of solder was used? Document all locations where lead solder was used.	Unknown	
3. Where are the most recent plumbing repairs and replacements?	Location: None	Description:
4. With what materials is the service connection (the pipe that carries water to the school from the public water system's main in the street) made? Where is the Service Line located? (This is the POE location.)	Material: Copper and Steel Location: Basement Boiler Room- Northeast Wall	
5. Is there point of entry (POE) or point of use (POU) treatment in use?	Y / N Type:	Location:

Questions	Answers
6. Are there tanks in your plumbing system (pressure tanks, gravity storage tanks)?	Y / N
7. Does the school have a filter maintenance and operation program? If so, who is responsible for this program? What is the process for adding filters?	No
8. Have accessible screens or aerators on outlets that provide drinking water been cleaned? Does the school have a screen or aerator maintenance program?	Y / N
9. Have there been any complaints about bad (metallic) taste? Note location(s).	Y / N Location:
10. Review records and consult with the public water supplier to determine whether any water samples have been taken in the building for any contaminants. If so, identify: • Name of contaminant(s) • Concentrations found • pH level Is testing done regularly at the building?	No
11. Other plumbing background questions include: • Are blueprints of the building available? • Are there known plumbing “dead-ends”, low use areas, existing leaks or other “problem areas”? Are renovations planned for any of the plumbing system?	No

Questions	Answers
Walk-Through <i>These questions should be addressed during the walk-through of the facility, while Attachment C- Drinking Water Outlet Inventory is being completed.</i>	
1. Confirm the material of Service Line visually.	Done
2. Confirm the presence of POE or POU treatment.	Done
3. What are the potable water pipes made of in your facility? • Lead • Plastic • Galvanized Metal • Cast Iron • Copper • Other Note the water flow through the building and the areas that receive water first, and which areas receive water last.	Copper, Steel and Brass
4. Are electrical wires grounded to Water Pipes? Note location(s).	Y / N Location: Basement Boiler Room- Northeast Wall
5. Are brass fittings, faucets, or valves used in your drinking water system? Note that most faucets are brass on the inside. Document the locations of any brass water outlet to be sampled.	Complete in "Brass" Column in Attachment C- Water Outlet Inventory. Yes
6. Locate all drinking water outlets (i.e. water coolers, bubblers, ice machines, kitchen/ food prep sinks, etc.) in the facility.	Complete in Attachment C-Water Outlet Inventory. Done

Questions	Answers	
7. Have the brands and models of the water coolers in the school been compared to the list of recalled water coolers in the Toolkit? Recalled Drinking Water Fountains Make and Model	Y / N Type	
8. Have signs of corrosion, such as frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry been detected? Note the locations of water outlets.	Complete in "Signs of Corrosion" column in Attachment C- Drinking Water Outlet Inventory. No	
9. Are there any outlets that are not operational and therefore out of service? Permanently? Temporarily? Permanently Temporarily	Y / N Complete "Operational Column" in Attachment C- Drinking Water Outlet Inventory. Type/ Location	Description

Attachment C – Drinking Water Outlet Inventory

Name of School: Cliffside Park

Address: 263 Lafayette Avenue, Cliffside Park, New Jersey

Grade Levels: Childcare Facility

Year School Constructed: N/A

Renovated/Additions: N/A

Individual school project officer Name/Signature: Gary Clare

Date Completed: June 17, 2025

# ¹	Type	Location	Code	Operational ² (Y/N)	Signs of Corrosion ³ (Y/N)	Filter ⁴ (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/ Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
01	Sink	Kitchen Sink – Sink Side B	DW-01	Y	N	N	Y	N	N	N/A	N/A	N	
02	Sink	Kitchen Sink – Sink Side D	DW-02	Y	N	N	Y	N	N	N/A	N/A	N	
03	Sink	Room 107 Classroom Sink	DW-03	Y	N	N	Y	N	N	N/A	N/A	N	
04	Sink	Room 107 Bathroom B4 Sink	DW-04	Y	Y	N	Y	N	N	N/A	N/A	N	
05	Sink	Gym – Girls Bathroom Left Sink	DW-05	Y	Y	N	Y	N	N	N/A	N/A	N	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

² Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

³ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

⁴ Document on Attachment D- Filter Inventory.

06	Sink	Gym – Boys Bathroom Left Sink	DW-06	Y	Y	N	Y	N	N	N/A	N/A	N	
07	Sink	First Floor Boy’s Bathroom – Middle Sink	DW-07	Y	Y	N	Y	N	N	N/A	N/A	N	
08	Sink	Room 104 Bathroom Sink	DW-08	Y	Y	N	Y	N	N	N/A	N/A	N	
09	Sink	First Floor Girls Bathroom – Middle Sink	DW-09	Y	Y	N	Y	N	N	N/A	N/A	N	
10	Sink	Health Director Office	DW-10	Y	Y	N	Y	N	N	N/A	N/A	N	
11	Sink	Adult Bathroom – Sink – 2 nd Floor	DW-11	Y	Y	N	Y	N	N	N/A	N/A	N	
12	Sink	2 nd Floor Girls Bathroom – Left Sink	DW-12	Y	Y	N	Y	N	N	N/A	N/A	N	
13	Sink	3rd Floor – Adult Bathroom - Sink	DW-13	Y	N	N	Y	N	N	N/A	N/A	N	

Attachment D - Filter Inventory

Name of School: Cliffside Park Head StartGrade Levels: Childcare FacilityAddress: 263 Lafayette Avenue, Cliffside Park, New JerseyIndividual School Project Officer: Gary ClareDate: July 17, 2025

Sample Location / Code	Brand	Type (Make & Model)	Date Installed or Replaced	Replacement Frequency	NSF Certified for Lead Reduction Y/N
DW-01	N/A	N/A	N/A	N/A	N/A
DW-02	N/A	N/A	N/A	N/A	N/A
DW-03	N/A	N/A	N/A	N/A	N/A
DW-04	N/A	N/A	N/A	N/A	N/A
DW-05	N/A	N/A	N/A	N/A	N/A
DW-06	N/A	N/A	N/A	N/A	N/A
DW-07	N/A	N/A	N/A	N/A	N/A
DW-08	N/A	N/A	N/A	N/A	N/A
DW-09	N/A	N/A	N/A	N/A	N/A
DW-10	N/A	N/A	N/A	N/A	N/A
DW-11	N/A	N/A	N/A	N/A	N/A
DW-12	N/A	N/A	N/A	N/A	N/A
DW-13	N/A	N/A	N/A	N/A	N/A

Attachment E – Flushing Log

Name of School: Cliffside Park Head Start

Address: 263 Lafayette Avenue, Cliffside Park, New Jersey

Grade Levels: Childcare Facility

Individual School Project Officer: Gary Clare

Date: 06/13/2025

Sample Location Description	Sample Location Code	Date	Time	Duration of Flushing	Reason for Flushing
Kitchen Sink –Side B	DW-01	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Kitchen Sink – Side D	DW-02	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Room 107 Classroom Sink	DW-03	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Room 107 Bathroom Sink	DW-04	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Gym – Girls Bathroom Left Sink	DW-05	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Gym – Boys Bathroom Right Sink	DW-06	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
First Floor Boy’s Bathroom – Middle Sink	DW-07	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Room 104 Bathroom Sink	DW-08	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
First Floor Girls Bathroom – Middle Sink	DW-09	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Health Director Office (Nurse) - Sink	DW-10	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
Adult Bathroom – Sink – 2 nd Floor	DW-11	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
2 nd Floor Girls Bathroom – Left Sink	DW-12	06/16/2025	3:00 pm	2-3 minutes	Water Sampling
3 rd Floor Adult Bathroom - Sink	DW-13	06/16/2025	3:00 pm	2-3 minutes	Water Sampling

Attachment F - Pre - Sampling Water Use Certification

TO BE COMPLETED BY THE CLIFFSIDE PARK DISTRICT REPRESENTATIVE:		
School Name: Cliffside Park Head Start		
Sample collection address: 263 Lafayette Avenue, Cliffside Park, New Jersey		
Water was last used:	Time: 3:00 PM	Date: June 5, 2023
Sample commencement:	Time: 7:05AM	Date: June 6, 2023
I have read the Lead Drinking Water Testing Sampling Plan and Quality Assurance Project Plan and I am certifying that samples were collected in accordance with these plans.		
Gary Clare		06/16/2025
Signature		Date

DRINKING WATER TESTING CHECKLIST

Note: This form is for child care centers that are supplied water by a community water system.

•PROGRAMS IN OPERATING PUBLIC SCHOOLS ARE NOT REQUIRED TO COMPLETE THIS FORM•

CHILD CARE CENTER INFORMATION

Name of Child Care Center:		License ID:	
Site Address of Center:	Building # and Street:	Municipality:	County:
Sponsor/Sponsor Representative:		Phone Number:	Email:

CERTIFICATION OF COMPLIANCE WITH LEAD & COPPER SAMPLING AT THE ABOVE CHILD CARE CENTER

Sampling Date(s):	
1. ☐ YES ☐ NO	Does the center have a signed contract with a New Jersey Certified Drinking Water Laboratory for lead & copper analysis?
2. ☐ YES ☐ NO	Is there an onsite water outlet assessment in accordance with technical guidance?
3. ☐ YES ☐ NO	Is there a floor plan in accordance with technical guidance?
4. ☐ YES ☐ NO Sample Date:	Were all the drinking water outlets in the center where a child or staff has or may have access (including food preparation and outside drinking water outlets) sampled?
5. ☐ YES ☐ NO Sample Date:	Were at least 50% of all indoor water faucets utilized by the center sampled?
6. ☐ YES ☐ NO	Does the child care center have the chain of custody and analytical reports for all drinking water outlets sampled? Please attach copies.
7. ☐ YES ☐ NO	Was all the drinking water outlets sampled in the sequence determined by the floor plan beginning with the outlet closest to the point of entry?
8. ☐ YES ☐ NO	Were all samples taken after the water sat undisturbed in pipes for at least 8 hours but no more than 48 hours?
9. ☐ YES ☐ NO	Were samples collected in pre-cleaned high density polyethylene (HDPE) 250 ml wide mouth single use rigid sample containers?
10. ☐ YES ☐ NO	Were all existing aerators, screens, and filters left in place prior to and during the sampling event?
11. ☐ YES ☐ NO	Were only cold water samples collected?
12. ☐ YES ☐ NO	Did no pre-stagnant flushing take place unless the outlet deviated from normal use and documented on flushing log?
13. ☐ YES ☐ NO	Was all point of use treatment on outlets, such as filters, documented?
14. ☐ YES ☐ NO	Did any result exceed the action level for lead (15 µg/L) or copper (1300 µg/L)?
15. ☐ YES ☐ NO ☐ N/A	If a result exceeded the action level for lead (15 µg/L) or copper (1300 µg/L) was use of all drinking water outlets immediately discontinued?
16. ☐ YES ☐ NO ☐ N/A	If a result exceeded the action level for lead (15 µg/L) or copper (1300 µg/L) was bottled water provided for drinking and food preparation?
17. ☐ YES ☐ NO ☐ N/A	If a result exceeded the action level for lead (15 µg/L) or copper (1300 µg/L) were signs posted to indicate that the outlets are not to be used for drinking or food preparation?

18. ☐ YES ☐ NO ☐ N/A	Did all drinking water outlets with a result that exceeded the action level for lead (15 µg/L) or copper (1300 µg/L) have a follow-up flush sample conducted?
19. ☐ YES ☐ NO ☐ N/A	If a result exceeded the action level for lead (15 µg/L) or copper (1300 µg/L) was the local health office notified of results?
20. ☐ YES ☐ NO ☐ N/A	If any of the results exceeded the action level for lead (15 µg/L) or copper (1300 µg/L), was notification, including results and remediation measures, provided to the parent(s) of all children attending the center, the staff, and NJDCF?
21. ☐ YES ☐ NO ☐ N/A	Were any drinking water outlets or potable plumbing replaced or repaired as a remedy for an action level exceedance?
22. ☐ YES ☐ NO ☐ N/A Sample Date:	If any drinking water outlet or potable plumbing was replaced or repaired, were additional samples collected after installation?
23. ☐ YES ☐ NO ☐ N/A	Was any chemical treatment unit or process installed to remedy an action level exceedance (e.g., corrosion control treatment)?
24. ☐ YES ☐ NO ☐ N/A Sample Date:	If a chemical treatment unit or process was installed to remedy an action level exceedance (e.g., corrosion control treatment), were additional samples collected after the installation?
25. ☐ YES ☐ NO ☐ N/A	Was a mechanical process implemented to remedy an action level exceedance (e.g., flushing program)?
26. ☐ YES ☐ NO ☐ N/A	If a mechanical process was implemented to remedy an action level exceedance (e.g., flushing program), were additional samples collected after the implementation?
27. ☐ YES ☐ NO ☐ N/A	If no remedial action was taken, such as those indicated in 21 through 26 above, has the center implemented a written plan of action for use of bottled water for drinking and food preparation?

CERTIFICATION: By signing below, the **Sponsor or Sponsor Representative** certifies that all answers on this checklist are true and accurate:

Sponsor/Sponsor Representative: (PRINT)	
Signature:	
Signature Date:	

DRINKING WATER TESTING RESOURCES

Schools - Lead Sampling Information

<http://www.nj.gov/dep/watersupply/schools.htm>

Lead Sampling in Schools Technical Guidance FAQs

<http://www.nj.gov/dep/watersupply/pdf/leadfaq.pdf>

3Ts for Reducing Lead in Drinking Water: Testing

<https://www.epa.gov/dwreginfo/3ts-reducing-lead-drinking-water-testing>

Quick Reference Guide Sampling For Lead in Drinking Water in Schools:

<http://www.nj.gov/dep/watersupply/pdf/quickref.pdf>

List of NJ Certified Laboratories:

<https://www13.state.nj.us/DataMiner/Search/SearchByCategory?isExternal=y&getCategory=y&catName=Certified+Laboratories>

Drinking Water Outlet Inventory Form:

http://www.nj.gov/dep/watersupply/doc/SP_Attachment%20C.docx

Sampling Water Use Certification:

http://www.nj.gov/dep/watersupply/doc/SP_Attachment%20F.docx

Filter Inventory Form:

http://www.nj.gov/dep/watersupply/doc/SP_Attachment%20D.docx

Results Letter Template:

<http://www.nj.gov/dep/watersupply/doc/resultsletter.doc>

State of New Jersey
Department of Children and Families
Office of Licensing

DRINKING WATER TESTING STATEMENT OF ASSURANCE

• PROGRAMS IN OPERATING PUBLIC SCHOOLS ARE NOT REQUIRED TO COMPLETE THIS FORM •

Name of Child Care Center:		License ID:
Site Address (Building # and Street): 263 Lafayette Avenue		
Municipality:	County:	
Sponsor/Sponsor Representative:		Phone #: (800) 423-0766
Sponsor/Sponsor Representative Email: Gclare@mccabeenv.com		
Additional Contact Person:		Phone #:
Title:	Email:	

1. The center, as described above, has reviewed the MANUAL OF REQUIREMENTS FOR CHILD CARE CENTERS requiring testing for lead and copper in drinking water and provides assurance that the development and implementation of a testing program was completed in accordance with N.J.A.C. 3A:52-5.3(i)5i as evidenced by our completion of the attached Drinking Water Testing Checklist.
2. The center, as described above, provided all notifications of test results consistent with the requirements of this subchapter.
3. The center, as described above, will continue to fully implement the requirements of this subchapter, including the continuance of any actions taken in response to a lead or copper action level exceedance (e.g., continue to provide bottled water and/or maintain any remedial measure or treatment unit).

CERTIFICATION: By signing below, the **Sponsor or Sponsor Representative** certifies that all statements above are true and accurate:

Sponsor/Sponsor Representative: (PRINT)	
Signature:	
Signature Date:	

APPENDIX C

SAMPLE LOCATION DRAWING

C

B




A

Cliffside Park Head Start
Lead & Copper in Drinking Water Sample Locations

C

Key	
O	Drinking Water Sample Locations

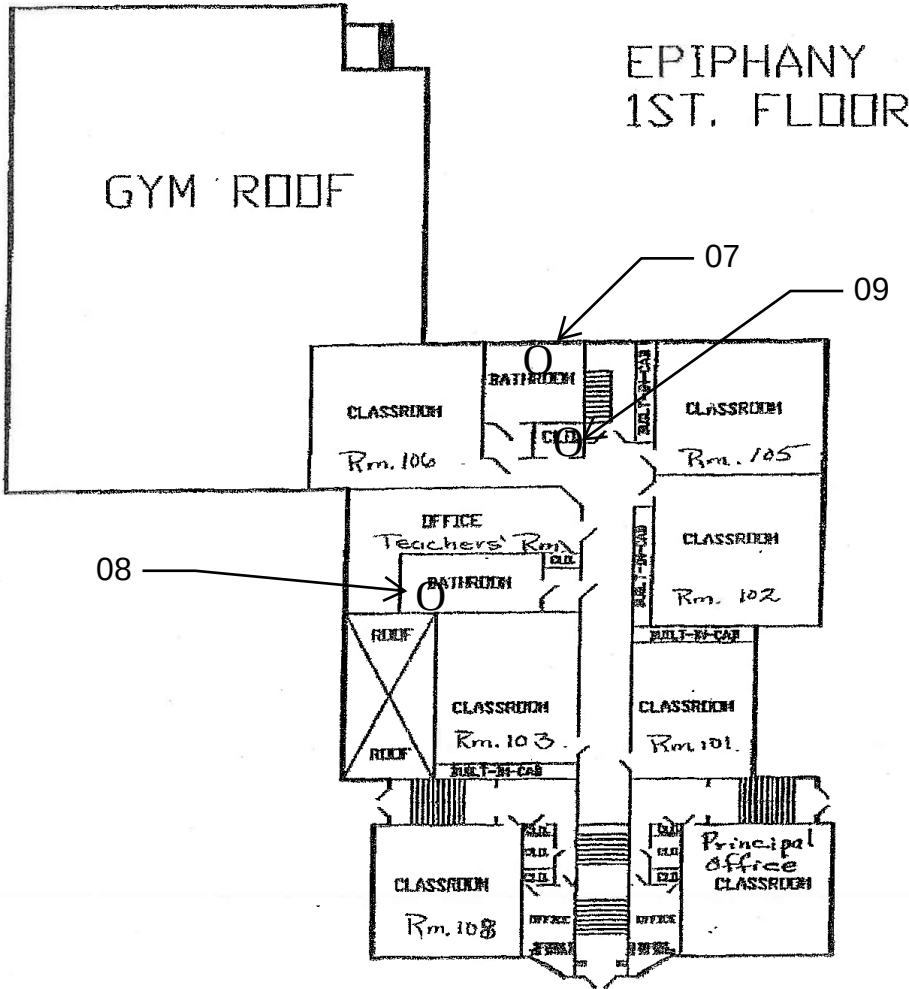

B


D

A

Cliffside Park Head Start
Lead & Copper in Drinking Water Sample Locations

C

Key	
O	Drinking Water Sample Locations

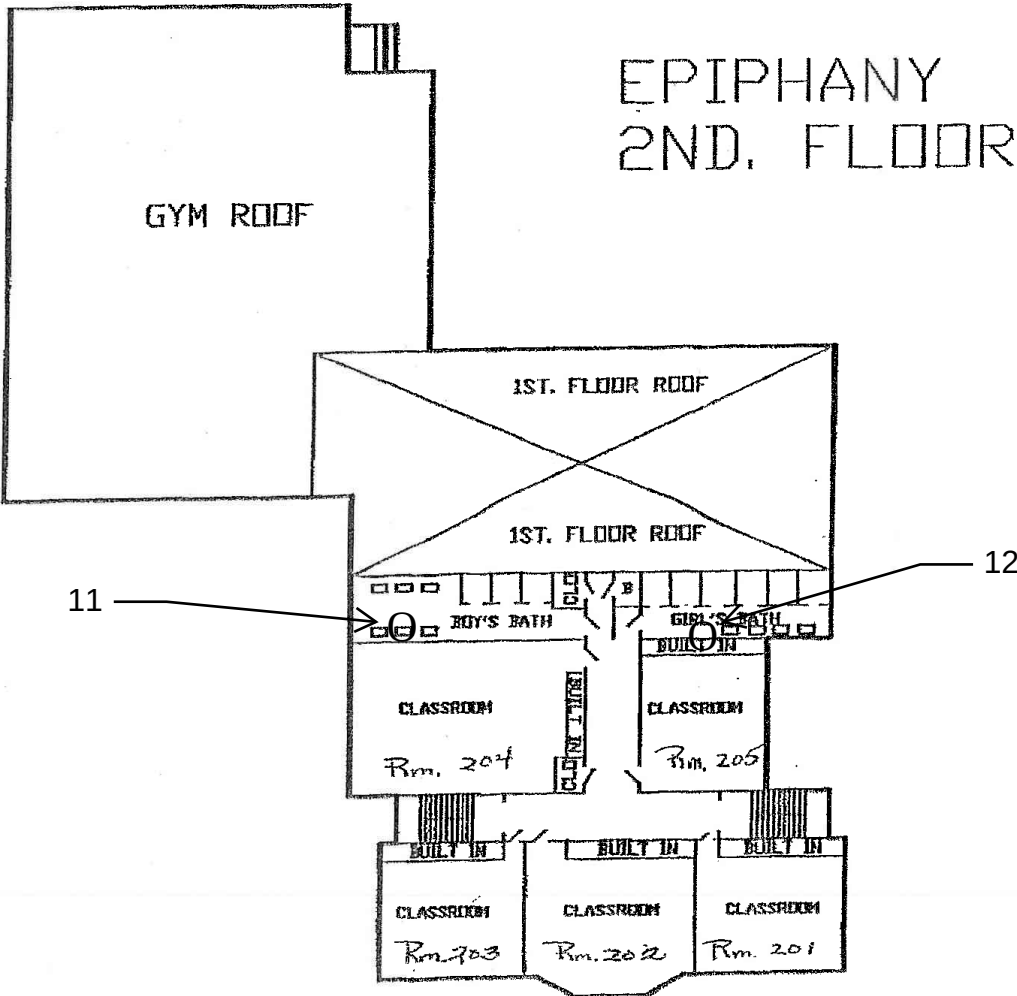

B

D

A


Cliffside Park Head Start
Lead & Copper in Drinking Water Sample Locations

C

Key	
O	Drinking Water Sample Locations

B

D

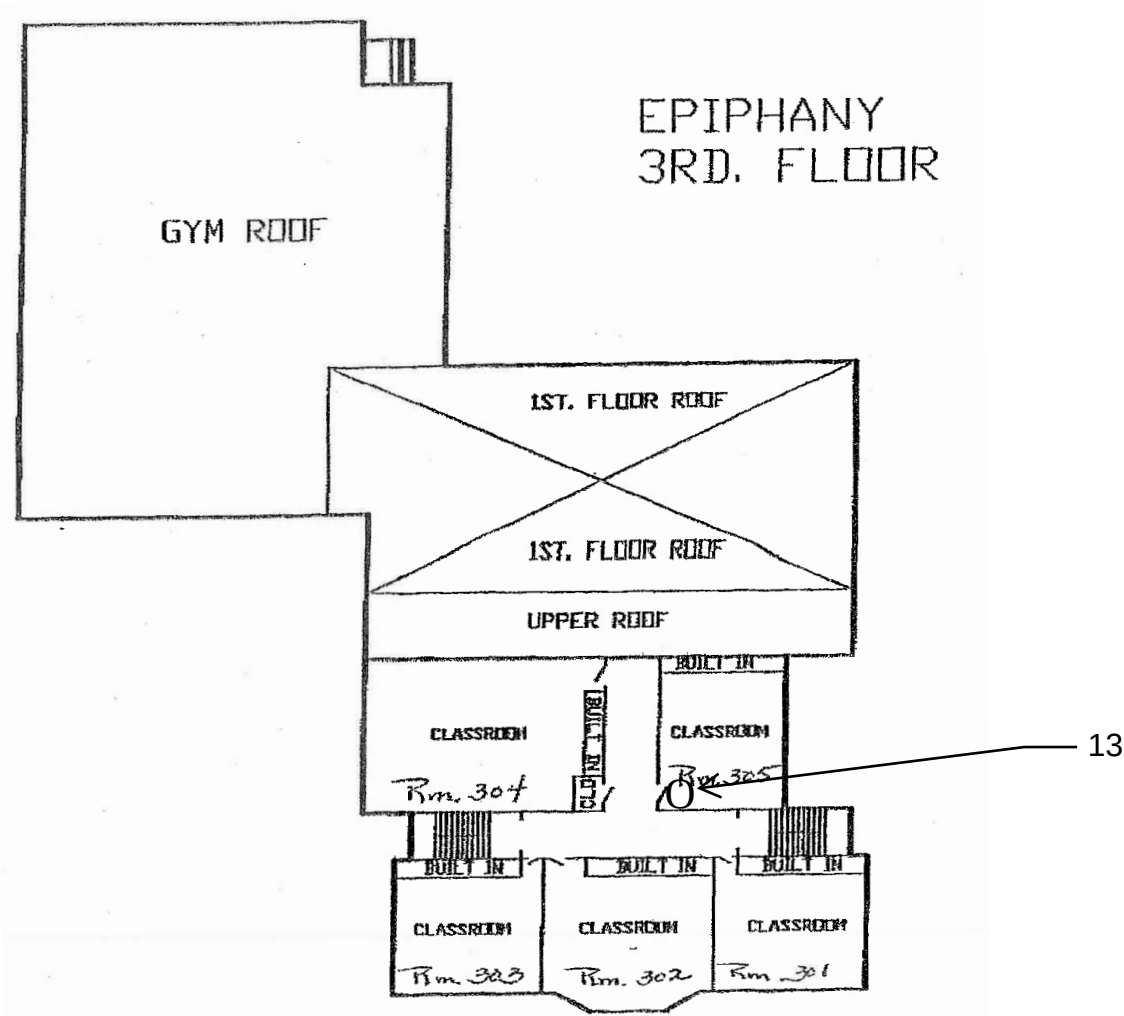

A